



VETERINARY EMERGENCY GROUP



3255 CROMPOND RD YORKTOWN NY 10598
914-739-9059 WWW.SIGNSINK.COM

PERMANENT SIGNAGE

VEG DUBLIN

3800 TULLER RD, DUBLIN, OHIO

EXISTING STOREFRONT



EXISTING STOREFRONT

NORTH



WEST



EAST



ENTRANCE MONUMENT



SAWMILL ROAD MONUMENT




STOREFRONT LOGO




MONUMENT



PYLON AND MONUMENT PLACEMENT

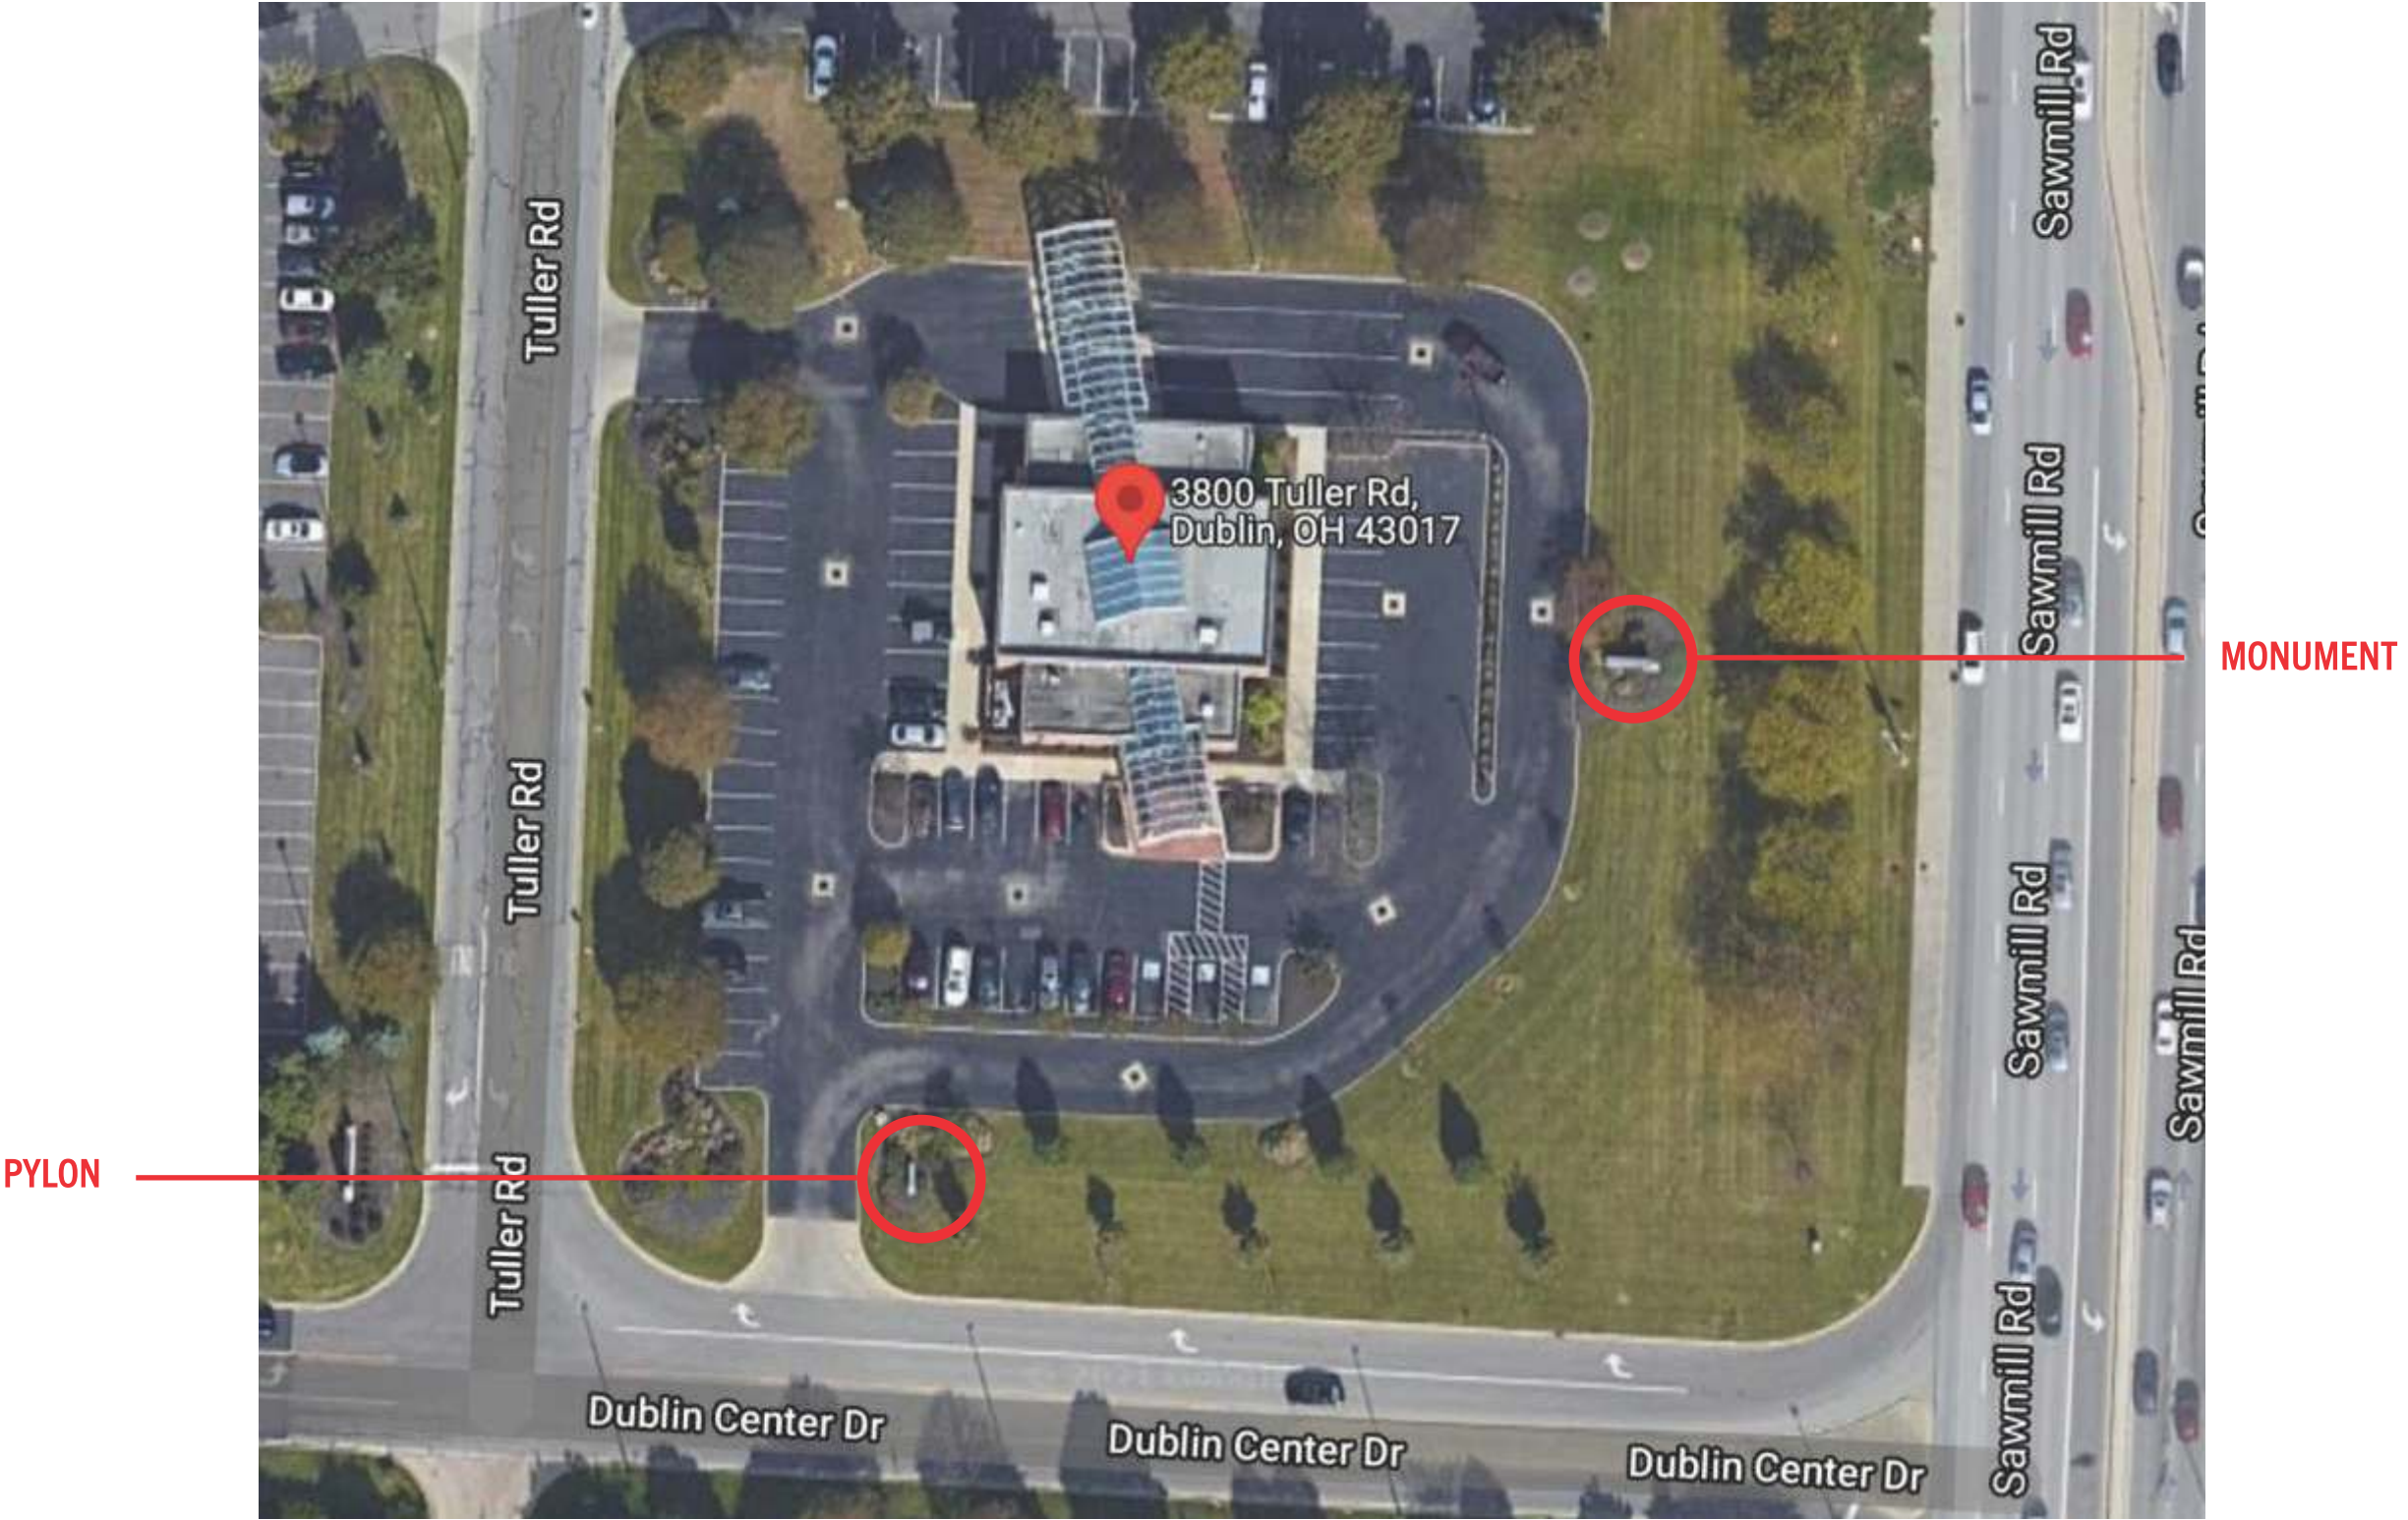

PYLON AND MONUMENT PLACEMENT

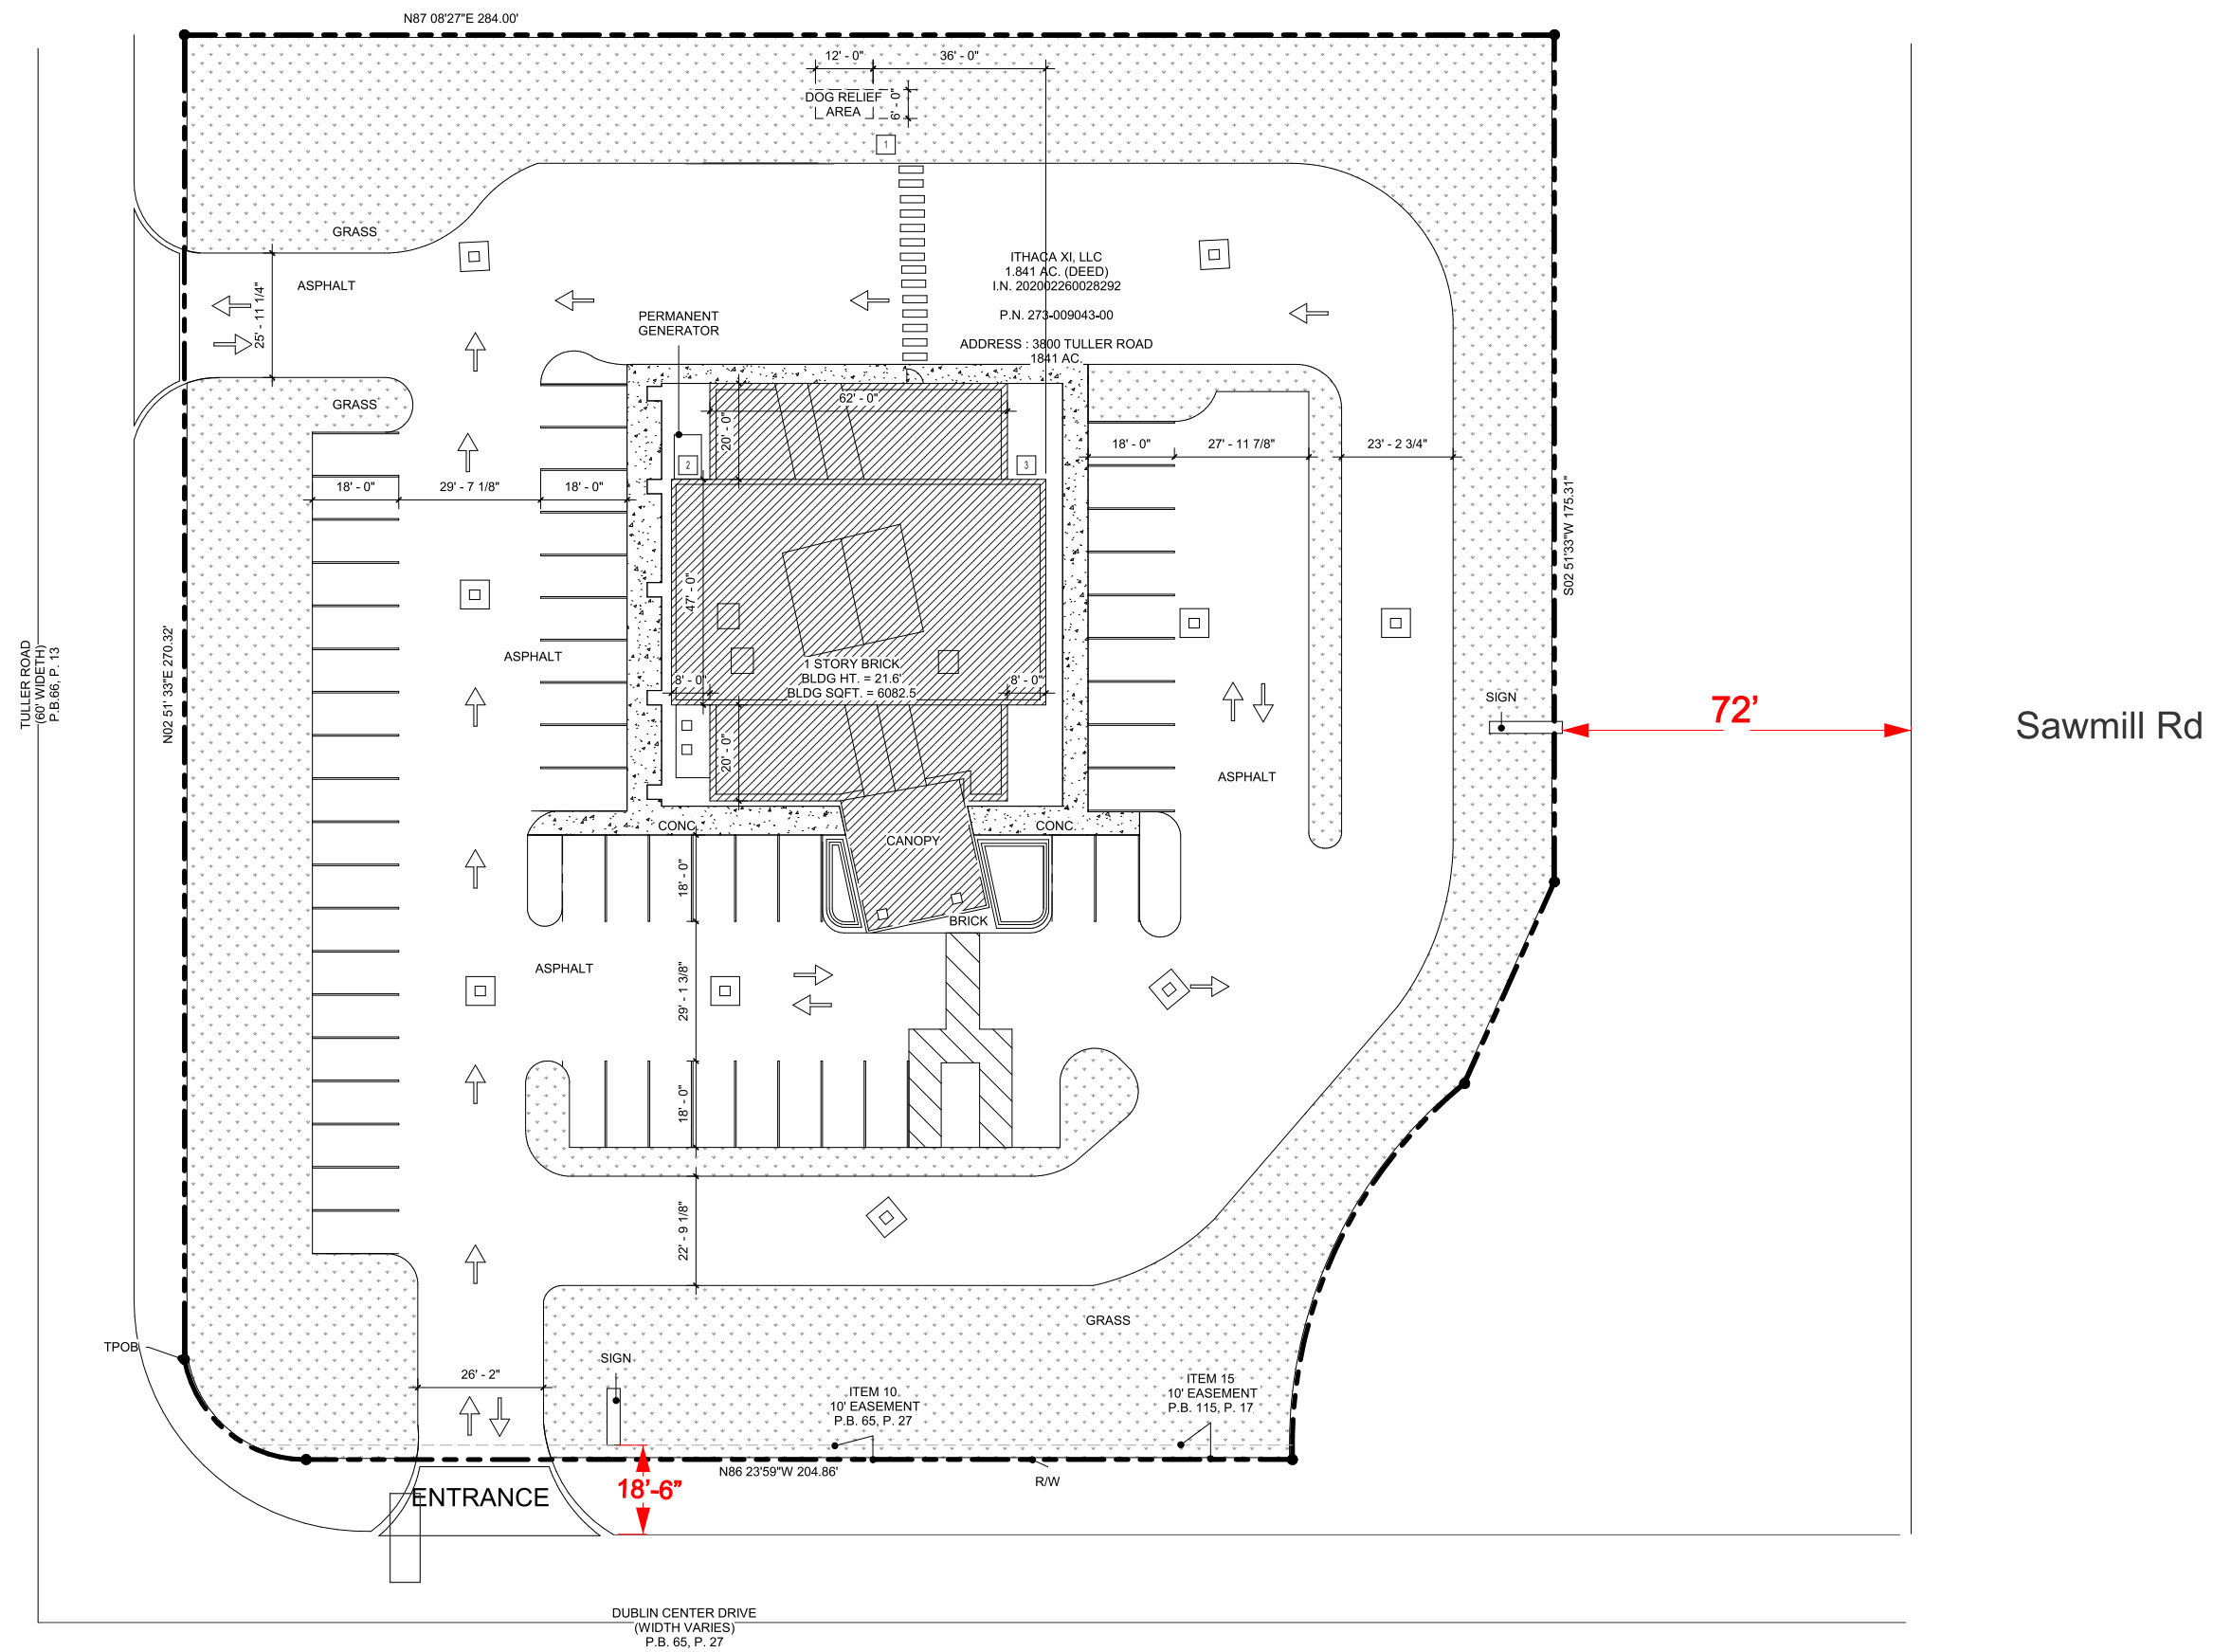

3800 TULLER RD, DUBLIN, OHIO

MONUMENT



SIGNAGE INFO


- Signage Code Allowance: TOTAL 66 sq ft
- Building 170' set back from the road
- Sign Style: stencil cut push thru monument sign
Mounted on existing brick base

OVERALL DIMENSIONS: 4'x 5'

SIGN SQ FT: 20 sq ft



PMS 485



DAY NIGHT
LIGHTS WHITE AT NIGHT



3255 CROMPOND RD YORKTOWN NY 10598
914-739-9059 WWW.SIGNSINK.COM

1.99 sq ft 10%

4 sq ft 20%



MONUMENT




SIGNAGE INFO


- Signage Code Allowance: TOTAL 66 sq ft
- Building 170' set back from the road
- Existing Chase Sign was 10'-4" W x 4' H
- Chase had no other signs on the building
- Sign Style: stencil cut push thru monument sign with black base

OVERALL DIMENSIONS: 8'-5"W x 5'-4"

SIGN SQ FT: 45.33 sq ft



PMS 485



DAY NIGHT
LIGHTS WHITE AT NIGHT



3255 CROMPOND RD YORKTOWN NY 10598
914-739-9059 WWW.SIGNSINK.COM




MONUMENT

3800 TULLER RD, DUBLIN, OHIO

LETTER ONLY LIGHT AT NIGHT

UL approved weather proof, 20 amp electrical service
Disconnect switch as per nec 600.6(a)(1), connected
To time clock or photocell as per sfb 4503.5c
requirements. The location of the disconnect
switch after installation shall comply with
article 600.6(a)(1) of the national electrical code.

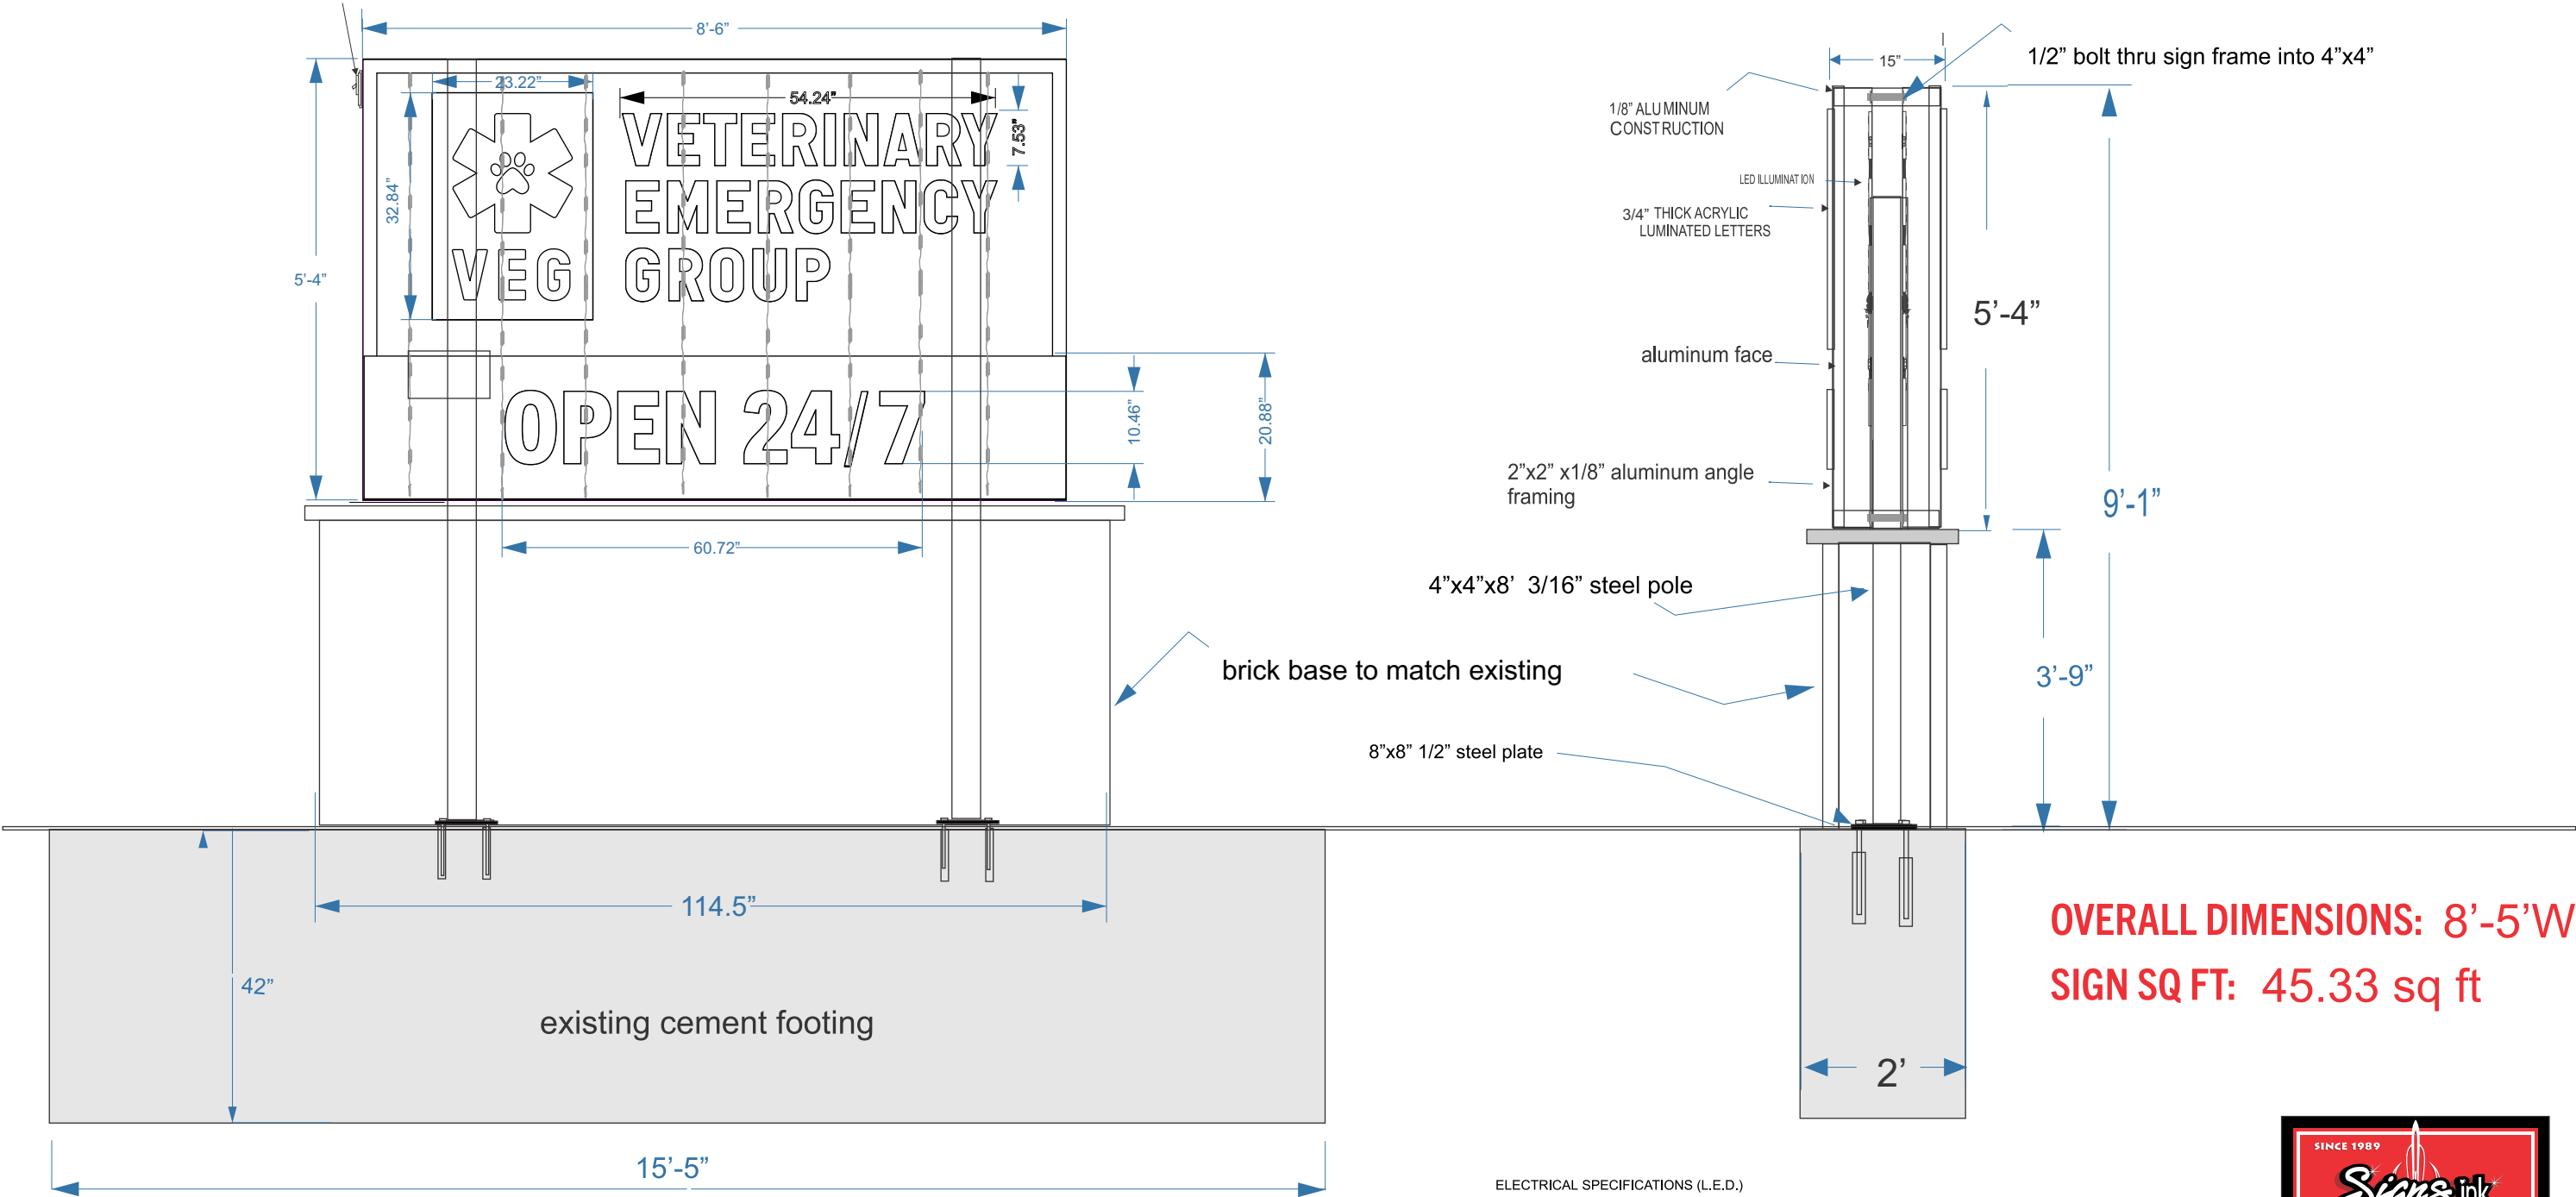

ELECTRICAL SPECIFICATIONS (L.E.D.)

ALL ELECTRICAL COMPONENTS WILL BE UL LISTED AND APPROVED
AS PER NEC 600.4, 600.3 & DESIGNED TO UL #48 PER F.S. 555-19.
ALL SIGNS ARE TO BE GROUNDED AND BONDED PER NEC 600.7 AND 250.
ALL WIRING INSIDE LETTERS WILL BE 12V • CLASS 2 18GA / LOW VOLTAGE WIRING.
ALL PRIMARY WIRING WILL BE #12 TWHN HIGH TENSION AS PER NEC 600.12(C).
THESE PLANS COMPLY WITH FBC 4505-21.
JUNCTION BOX INSTALLED BY CUSTOMER'S ELECTRICAL CONTRACTOR
TO WITHIN 6" OF SIGN LOCATION.
HVHZ 1620 WITH WIND LOADS PER ASCE 7-10.



3255 CROMPOND RD YORKTOWN NY 10598
914-739-9059 WWW.SIGNSINK.COM