

FLOOR PLAN LEGEND

APPLIED BUILDING
CONSTRUCTION
BPS.15-22369.CO
M.COM EPR.1883
36211
06/08/16

INDICATES PARTITION WITH SOUND ATTENUATION INSULATION. REFER TO THE WALL PARTITION SCHEDULE.

2 HR RATED WALL

1/2 HR RATED WALL

PLANE ELEVATION

MAIL BOX

PARCEL BOX

LINE INDICATES ORIENTATION OF KEYHOLE FOR FOR ANSI COMPLIANCE

SEMI-RECESSED FIRE EXTINGUISHER CABINET. INSTALL FIRE EXTINGUISHER SO THAT THE INTEGRITY OF RATED WALL IS MAINTAINED. CONTINUE TYPE X GYP BOARD ASSEMBLY BEHIND FIRE EXTINGUISHER CABINET. UNIT SHALL NOT ENCRoACH MORE THAN 4" INTO THE PATH OF EGRESS.

PORTABLE FIRE EXTINGUISHER

HEARING IMPAIRED UNIT. SEE MEP INFORMATION FOR ADDITIONAL REQUIREMENTS. SEE CODE FLOOR PLANS FOR LOCATIONS

TYPE A FULLY ACCESSIBLE UNIT. SEE CODE FLOOR PLANS FOR LOCATIONS

REQUIRED 30"x48" WHEELCHAIR CLEARANCE. 48" SHALL BE CENTERED AT SINKS AND KITCHEN RANGE

2'-10" MAXIMUM HEIGHT TO THE TOP OF THE KITCHEN OR BATHROOM SINK RIM. TYP. AT PUBLIC AREAS & TYPE A ANSI UNITS

ELECTRIC FIRE PLACE AND GYPSUM BOARD SURROUND TYP. AT ALL 1, 2 AND 3-BEDROOM PENTHOUSE UNITS U.N.O.

BALCONY

UNIT INTERIOR

MECHANICAL LOWER PAINT TO MATCH TO EXT. FINISH


VTAC FLOOR PLAN DIAGRAM (VTAC UNIT TO BE INSTALLED AT TYPICAL RESIDENTIAL LEVELS. AT PENTHOUSE LEVEL ONLY. LOCATE CLOSET AND DOOR IN LIEU OF VTAC UNIT)

TYPICAL ACCESS PANEL LOCATION FOR MECHANICAL UNIT. ACCESS PANEL TO BE PAINTED TO MATCH ADJACENT WALL

GENERAL NOTES - FLOOR PLAN

- ALL DIMENSIONS ARE TO FACE OF WALL UNLESS NOTED OTHERWISE.
- SEE STRUCTURAL DRAWINGS FOR LOCATIONS OF ALL STEEL REINFORCING IN WALL & FLOOR CONSTRUCTION.
- SEE FINISH SCHEDULE FOR ADDITIONAL INFORMATION OF LOCATIONS AND TYPES OF FINISH MATERIALS.
- SEE ELEVATIONS AND STRUCTURAL DRAWINGS FOR LOCATIONS OF EXPANSION & CONTROL JOINTS. CONTRACTOR SHALL PROVIDE ADDITIONAL INTERIOR CONTROL JOINTS AS REQUIRED TO COMPLY WITH MAXIMUM SPACING REQUIREMENTS IN SPECIFICATIONS AND NATIONAL MASONRY INSTITUTE. SEE DETAILS ON ADOX.
- MECHANICAL & ELECTRICAL EQUIPMENT SHALL BE ON HOUSEKEEPING PADS. PADS ARE TO PROVIDED BY THE TRADE SUPPLYING THE EQUIPMENT. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION. WORK TO BE COORDINATED THROUGH THE GENERAL TRADES CONTRACTOR. PADS 4" MIN. 4" THICK W/ W.W.F. UNLESS NOTED OTHERWISE.
- SEE G SERIES SHEETS FOR WALL TYPE CONSTRUCTION.
- PROVIDE AN 24" X 36" FIRE RATED ACCESS PANEL PER FLOOR AT ALL KITCHEN GREASE SHAF LOCATIONS AND EVERY OTHER FLOOR FOR ALL OTHER SHAF LOCATIONS. ACCESS PANELS TO FACE THE PUBLIC CORRIDOR SIDE. COORDINATE MOUNTING HEIGHT WITH ARCHITECT IN THE FIELD.
- DO NOT RUN PIPELINE, CONDUITS OR ANY DEVICES INTO THE SHAF ASSEMBLIES. SHAF ASSEMBLIES TO REMAIN FOR THE SOLE PURPOSE OF THE MECHANICAL DUCTS.
- ELEVATION 810.00 EQUALS 100'-0"
- INSTALL FIRE EXTINGUISHER SO THE INTEGRITY OF THE RATED WALL IS MAINTAINED. CONTINUE THE TYPE X GYPSUM BOARD ASSEMBLY BEHIND THE FIRE EXTINGUISHER CABINET.
- SEE ADOX SERIES SHEETS FOR UNIT LAYOUT INFORMATION.
- ALL WOOD SILL PLATES IN WALLS AT PODIUM LEVEL TO BE PRESSURE TREATED.
- EXTERIOR BEARING WALLS TO BE 1 HOUR RATED PER U.L.# U364. REFER TO STRUCTURAL SHEETS FOR BEARING WALL CONDITIONS.
- COORDINATE SHAF WALL ALIGNMENT WITH ARCHITECT TO MAINTAIN REQUIRED RATING IN ADJACENT WALLS.

KEY PLAN

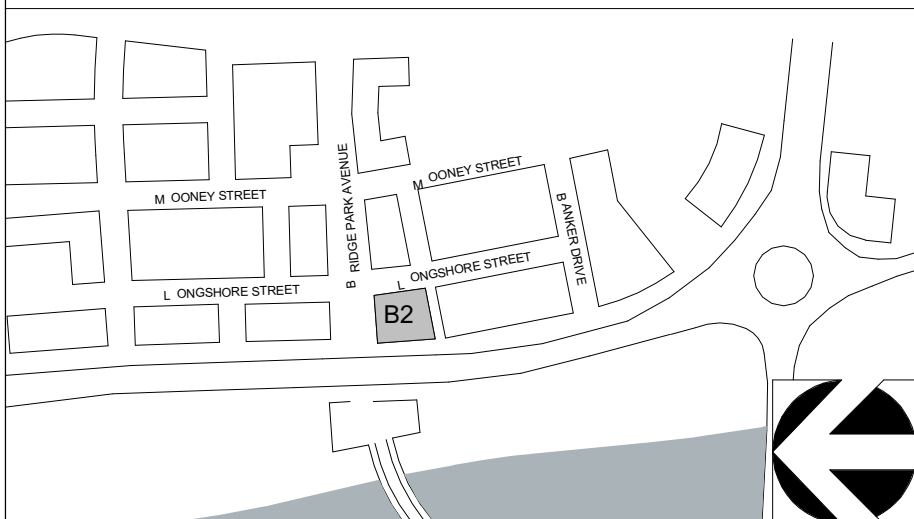

#	DATE	CHANGE DESCRIPTION


BRIDGE PARK BUILDING B2
6580 RIVERSIDE DR. DUBLIN, OHIO 43017



MOODY•NOLAN
RESPONSIVE ARCHITECTURE

300 Spruce Street
Suite 300
Columbus, Ohio 43215


Phone: (614) 461-6664
Fax: (614) 280-8881
www.moodynolan.com

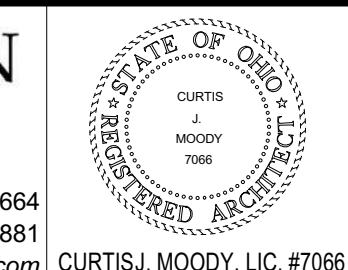

Dwg. Coord.: Author Tech. Coord.: Checker 14145

LEVEL 2 - FLOOR PLAN
GMP/PERMITSET

A121
08-03-2015




	1) CAGES PARTITION WITH SOUND ATTENUATION INSULATION. REFER TO THE WALL PARTITION SCHEDULE 1) HR RATED WALL
2) HR RATED WALL	
3) HR RATED WALL	
<p>Applied Tech Construction BPS-15-22369.CO M.COM FPR.1883 36211 02/24/17</p>	
<p>ONE SHAF TYPED WALL NOTED OTHERWISE. SEE G SERIES SHEETS FOR WALL TYPE CHANGES. SEE G SERIES SHEETS FOR INTERIOR WALLS. SHAF TYPED WALL ASSEMBLY TO BE CONTINUED AND THROUGH THE ROOF. WALL ASSEMBLY TO GO TO THE FLOORING PRODUCT EXCEPT AT SUPPLY AND VENTILATION AND FOR IDENTICAL CONDITIONS PROVIDE A HORIZONTAL SHAF TYPED WALL AT THE BOTTOM OF THE SHAF TYPED. SEE THE GENERAL NOTES ON THE SHEET FOR ACCESS PANEL REQUIREMENTS AT SHAF TYPED ENCLOSURE. SEE THE SHAF TYPED VERTICAL DETAILS.</p>	
	PLAN ELEVATION
	MAIL BOX PARCEL BOX
	LINE INDICATES ORIENTATION OF KEYHOLE FOR FOR ANSI COMPLIANCE
<p>SEMI-RECESSED FIRE EXTINGUISHER CABINET. INSTALL FIRE EXTINGUISHER SO THAT THE INTEGRITY OF RATED WALL IS MAINTAINED. CONTINUE TYPE G KYP BOARD ASSEMBLY BEHIND FIRE EXTINGUISHER CABINET. UNIT SHALL NOT ENDOARCH MORE THAN 4" INTO THE PATH OF EGRESS.</p>	
	PORTABLE FIRE EXTINGUISHER
	HEARING IMPAIRED UNIT. SEE MEP INFORMATION FOR ADDITIONAL REQUIREMENTS. SEE CODE FLOOR PLANS FOR LOCATIONS
	TYPE A FULLY ACCESSIBLE UNIT. SEE CODE FLOOR PLANS FOR LOCATIONS
<p>REQUIRED 30"x48" WHEELCHAIR CLEARANCE. 48" SHALL BE CENTERED AT SINKS AND KITCHEN RANGE.</p>	
<p>2'-10" MAXIMUM HEIGHT TO THE TOP OF THE KITCHEN OR BATHROOM SINK RIM. TYP. AT PUBLIC AREAS & TYPE A UNITS</p>	
<p>ELECTRIC FIRE PANEL AND GYPSUM BOARD SURROUND TYP. AT ALL 1, 2 AND 3-BEDROOM PENTHOUSE UNITS U.N.O.</p>	

2. ALL DIMENSIONS ARE TO FACE OF WALL (UNLESS NOTED OTHERWISE).
3. SEE ARCHITECTURAL DRAWINGS FOR LOCATIONS OF ALL STEEL REINFORCING IN WALL & FLOOR CONSTRUCTION.
4. SEE FINISH SCHEDULE FOR ADDITIONAL INFORMATION OF LOCATIONS OF FINISHES.
5. SEE ELEVATIONS AND STRUCTURAL DRAWINGS FOR LOCATIONS OF EXPANSION & CONTROL JOINTS. CONTRACTOR SHALL PROVIDE PROTECTIVE CURBS AT ALL JOINTS TO PREVENT FLOOR CRACKING WITH MAXIMUM SPACING REQUIREMENTS IN SPECIFICATIONS AND NATIONAL MASONRY REQUIREMENTS. SEE DETAILS ON AXXX.
6. PROVIDE ALL EJECTOR HOLES TO BE USED FOR HOUSEKEEPING PADS, ADDITIONAL TO PROVIDED BY THE TRADE SUPPLYING THE MECHANICAL EQUIPMENT. PROVIDE MECHANICAL EQUIPMENT FOR ADDITIONAL INFORMATION. WORK TO BE COORDINATED THROUGH THE GENERAL TRADES CONTRACTOR. PADS 4" MIN. x 4" THICK W/ 1/2" REINFORCING.
7. SEE G SERIES SHEETS FOR WALL TYPE CONSTRUCTION.
8. PROVIDE AN 2' x 36" FIRE RATED ACCESS PANEL PER FLOOR AT ALL EXTERIOR WALL LOCATIONS. PROVIDE 1/2" MIN. THICK FLOOR FOR ALL OTHER SHAFTS LOCATIONS. ACCESS PANELS TO FACE THE PUBLIC CORRIDOR SIDE. COORDINATE MOUNTING HEIGHT WITH ARCHITECT IN THE FIELD.
9. DO NOT RUN PIPELINE, CONDUTITS OR ANY DEVICES INTO THE SHAFT OR SHAFTHOUSE. PROVIDE A SIGN FOR THE MAINTENANCE FOR THE PURPOSE OF THE MECHANICAL DUTIES.
10. ELEVATION 810.000 ELEVATIONS 10'0"
11. CONTINUE THE WORKING OF THE INTEGRITY OF THE RATED WALL IS MAINTAINED. CONTINUE THE TYPE X GYPSUM BOARD ASSEMBLY BEHIND THE FIRE EXTINGUISHER CABINET.
12. SEE G SERIES SHEETS FOR ADDITIONAL INFORMATION.
13. ALL WOOD SILL PLATES IN WALLS AT PODIUM LEVEL TO BE PRESSURE TREATED.
14. EXTERIOR BEARING WALLS TO BE 1 HOUR RATED PER U.L. U364. REFER TO STRUCTURAL SHEETS FOR BEARING WALL CONDITIONS.
15. ALL SHAFTHOUSES TO BE COORDINATED WITH ARCHITECT TO MAINTAIN REQUIRED RATING IN ADJACENT WALLS.

#	DATE	CHANGE DESCRIPTION
1	8-21-15	ADDENDUM #1
5	3-23-16	BULLETIN #4
7	5-27-16	BULLETIN 7
11	Date 11	BULLETIN #13
13	12-22-16	BULLETIN #17

6580 RIVERSIDE DR. DUBLIN, OHIO 43017



CURTIS
J.
MOODY
7066

STATE OF OHIO
REGISTERED ARCHITECT

CURTIS J. MOODY, LIC. #7066

14145

A141


08-03-2015


1 PLAN

LEVEL 4 - FLOOR PLAN


1/8" = 1'-0"

REFER TO SHEET A131 FOR DIMENSIONS
AND WALL TYPES UNLESS NOTED ON PLAN



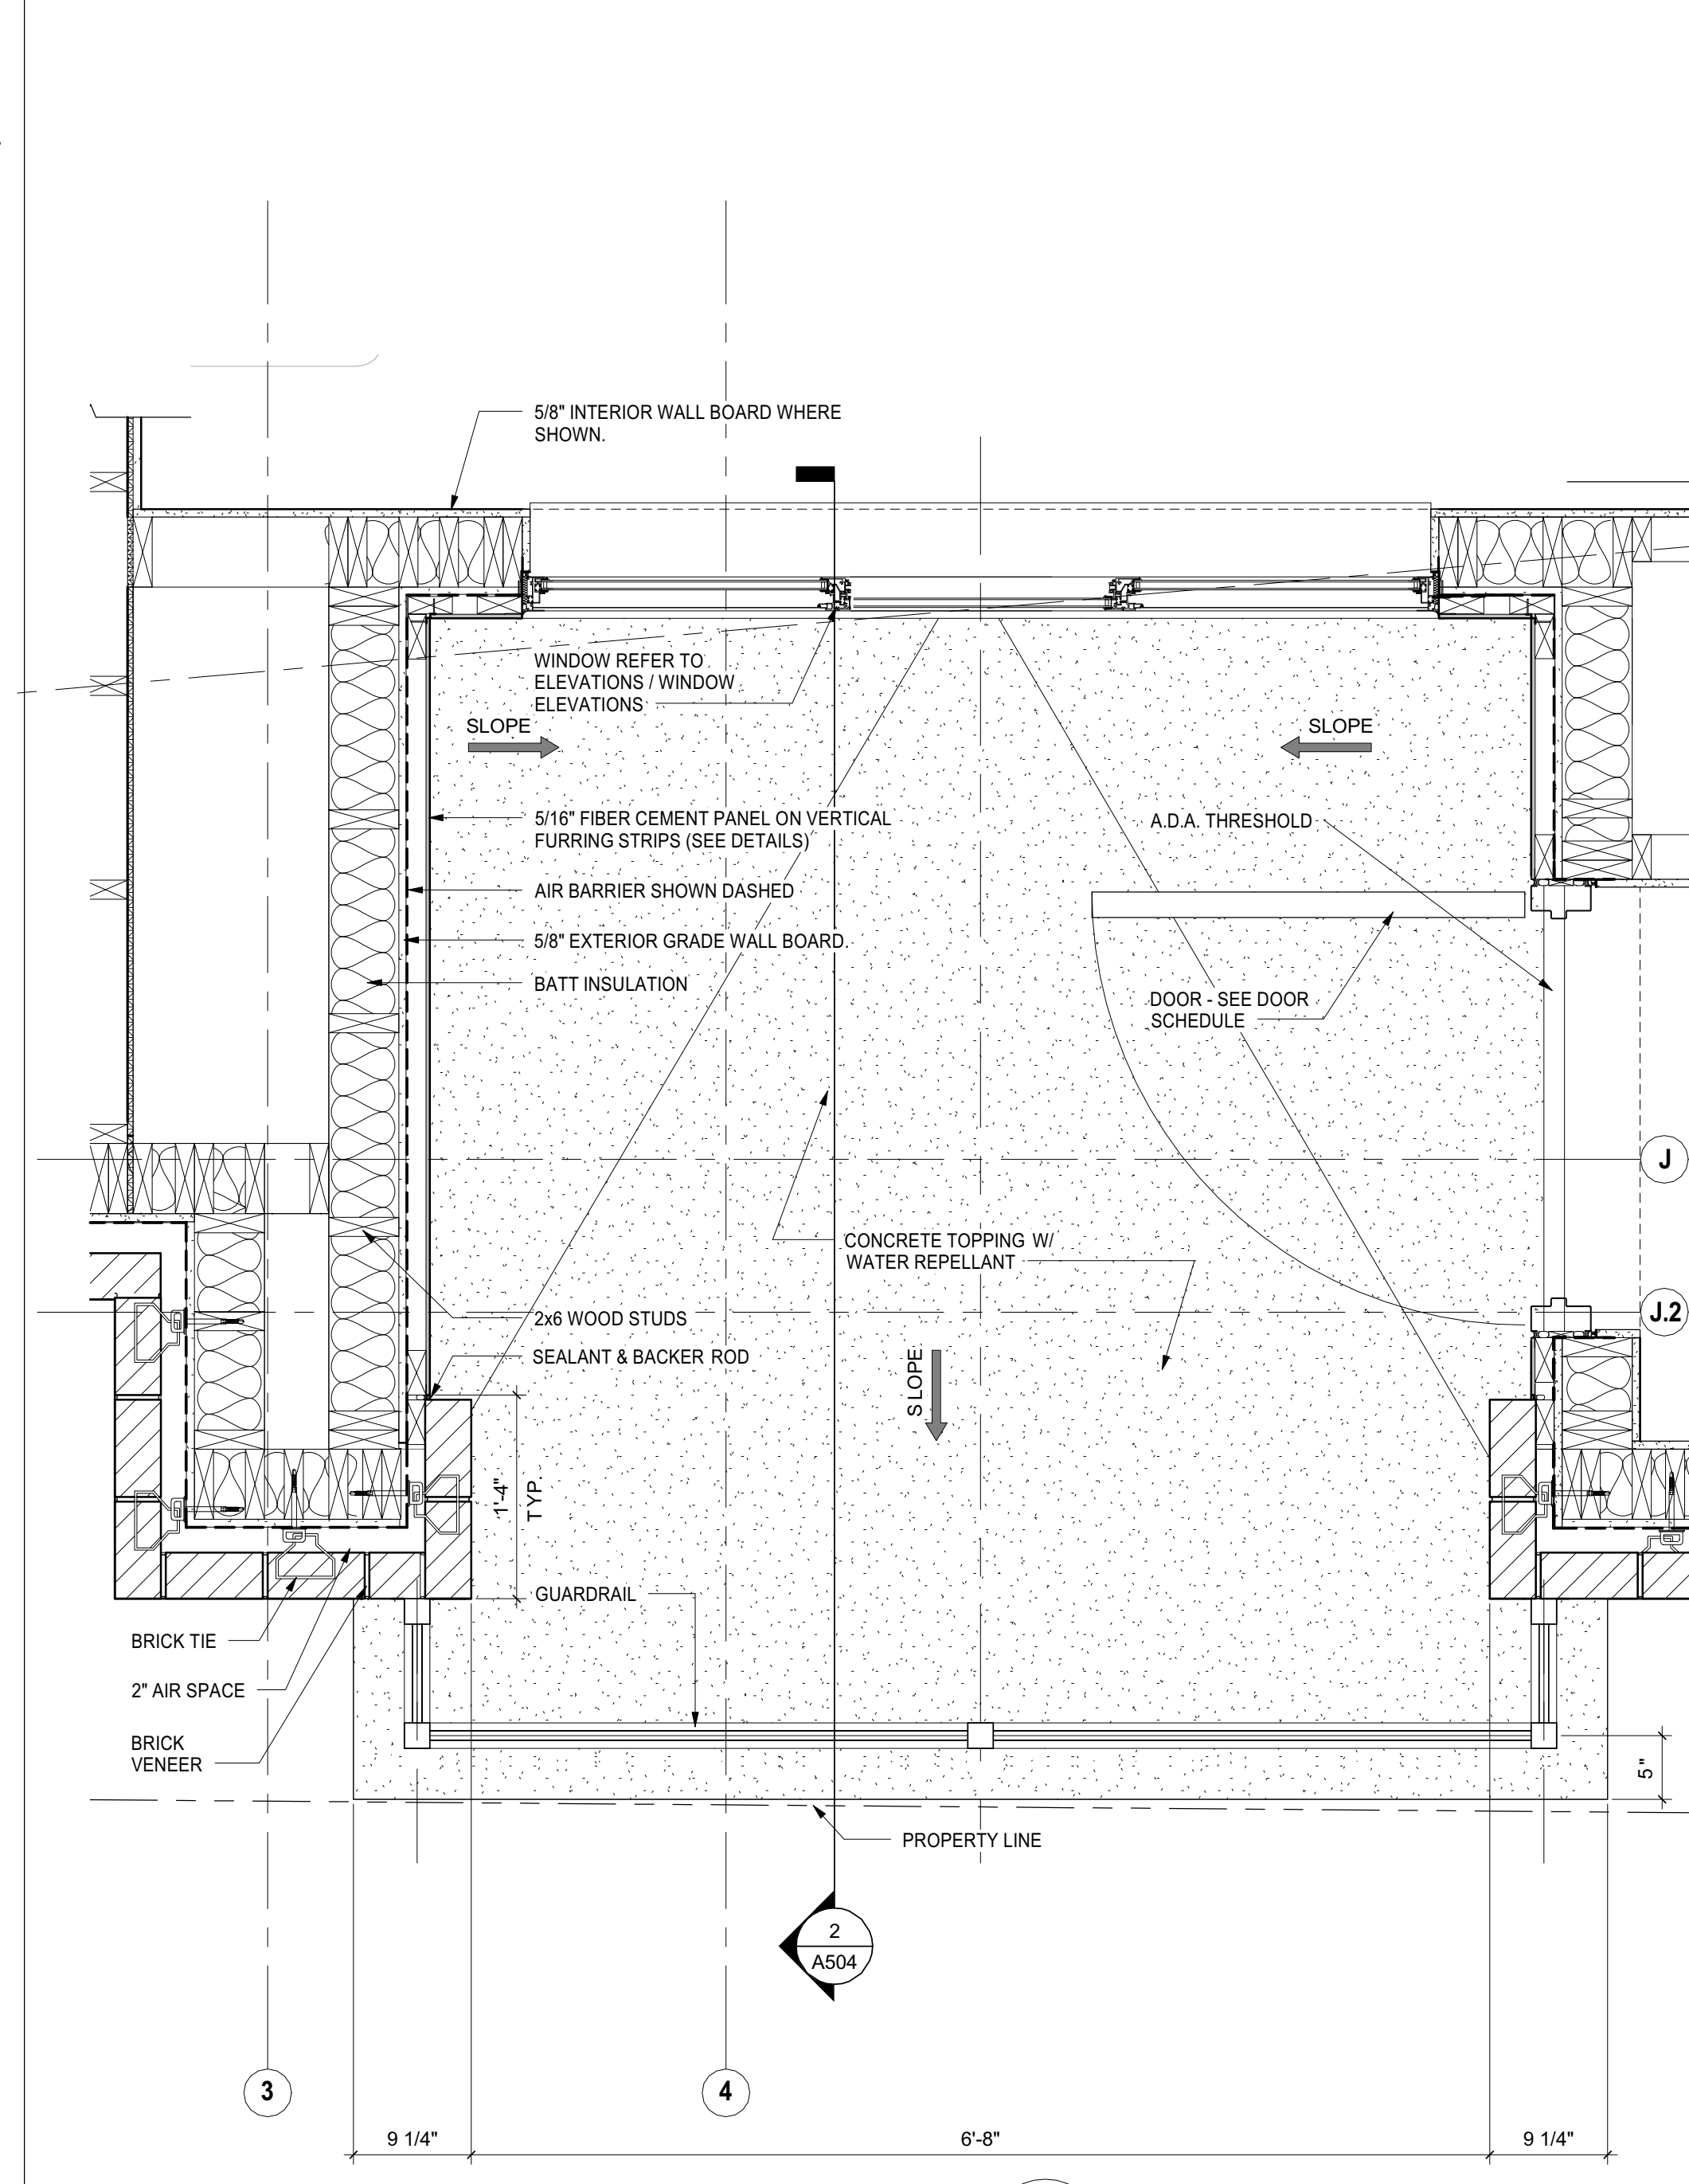


3 PLAN LEVEL 4 & 5 - WEST BALCONY
1" = 1'-0"

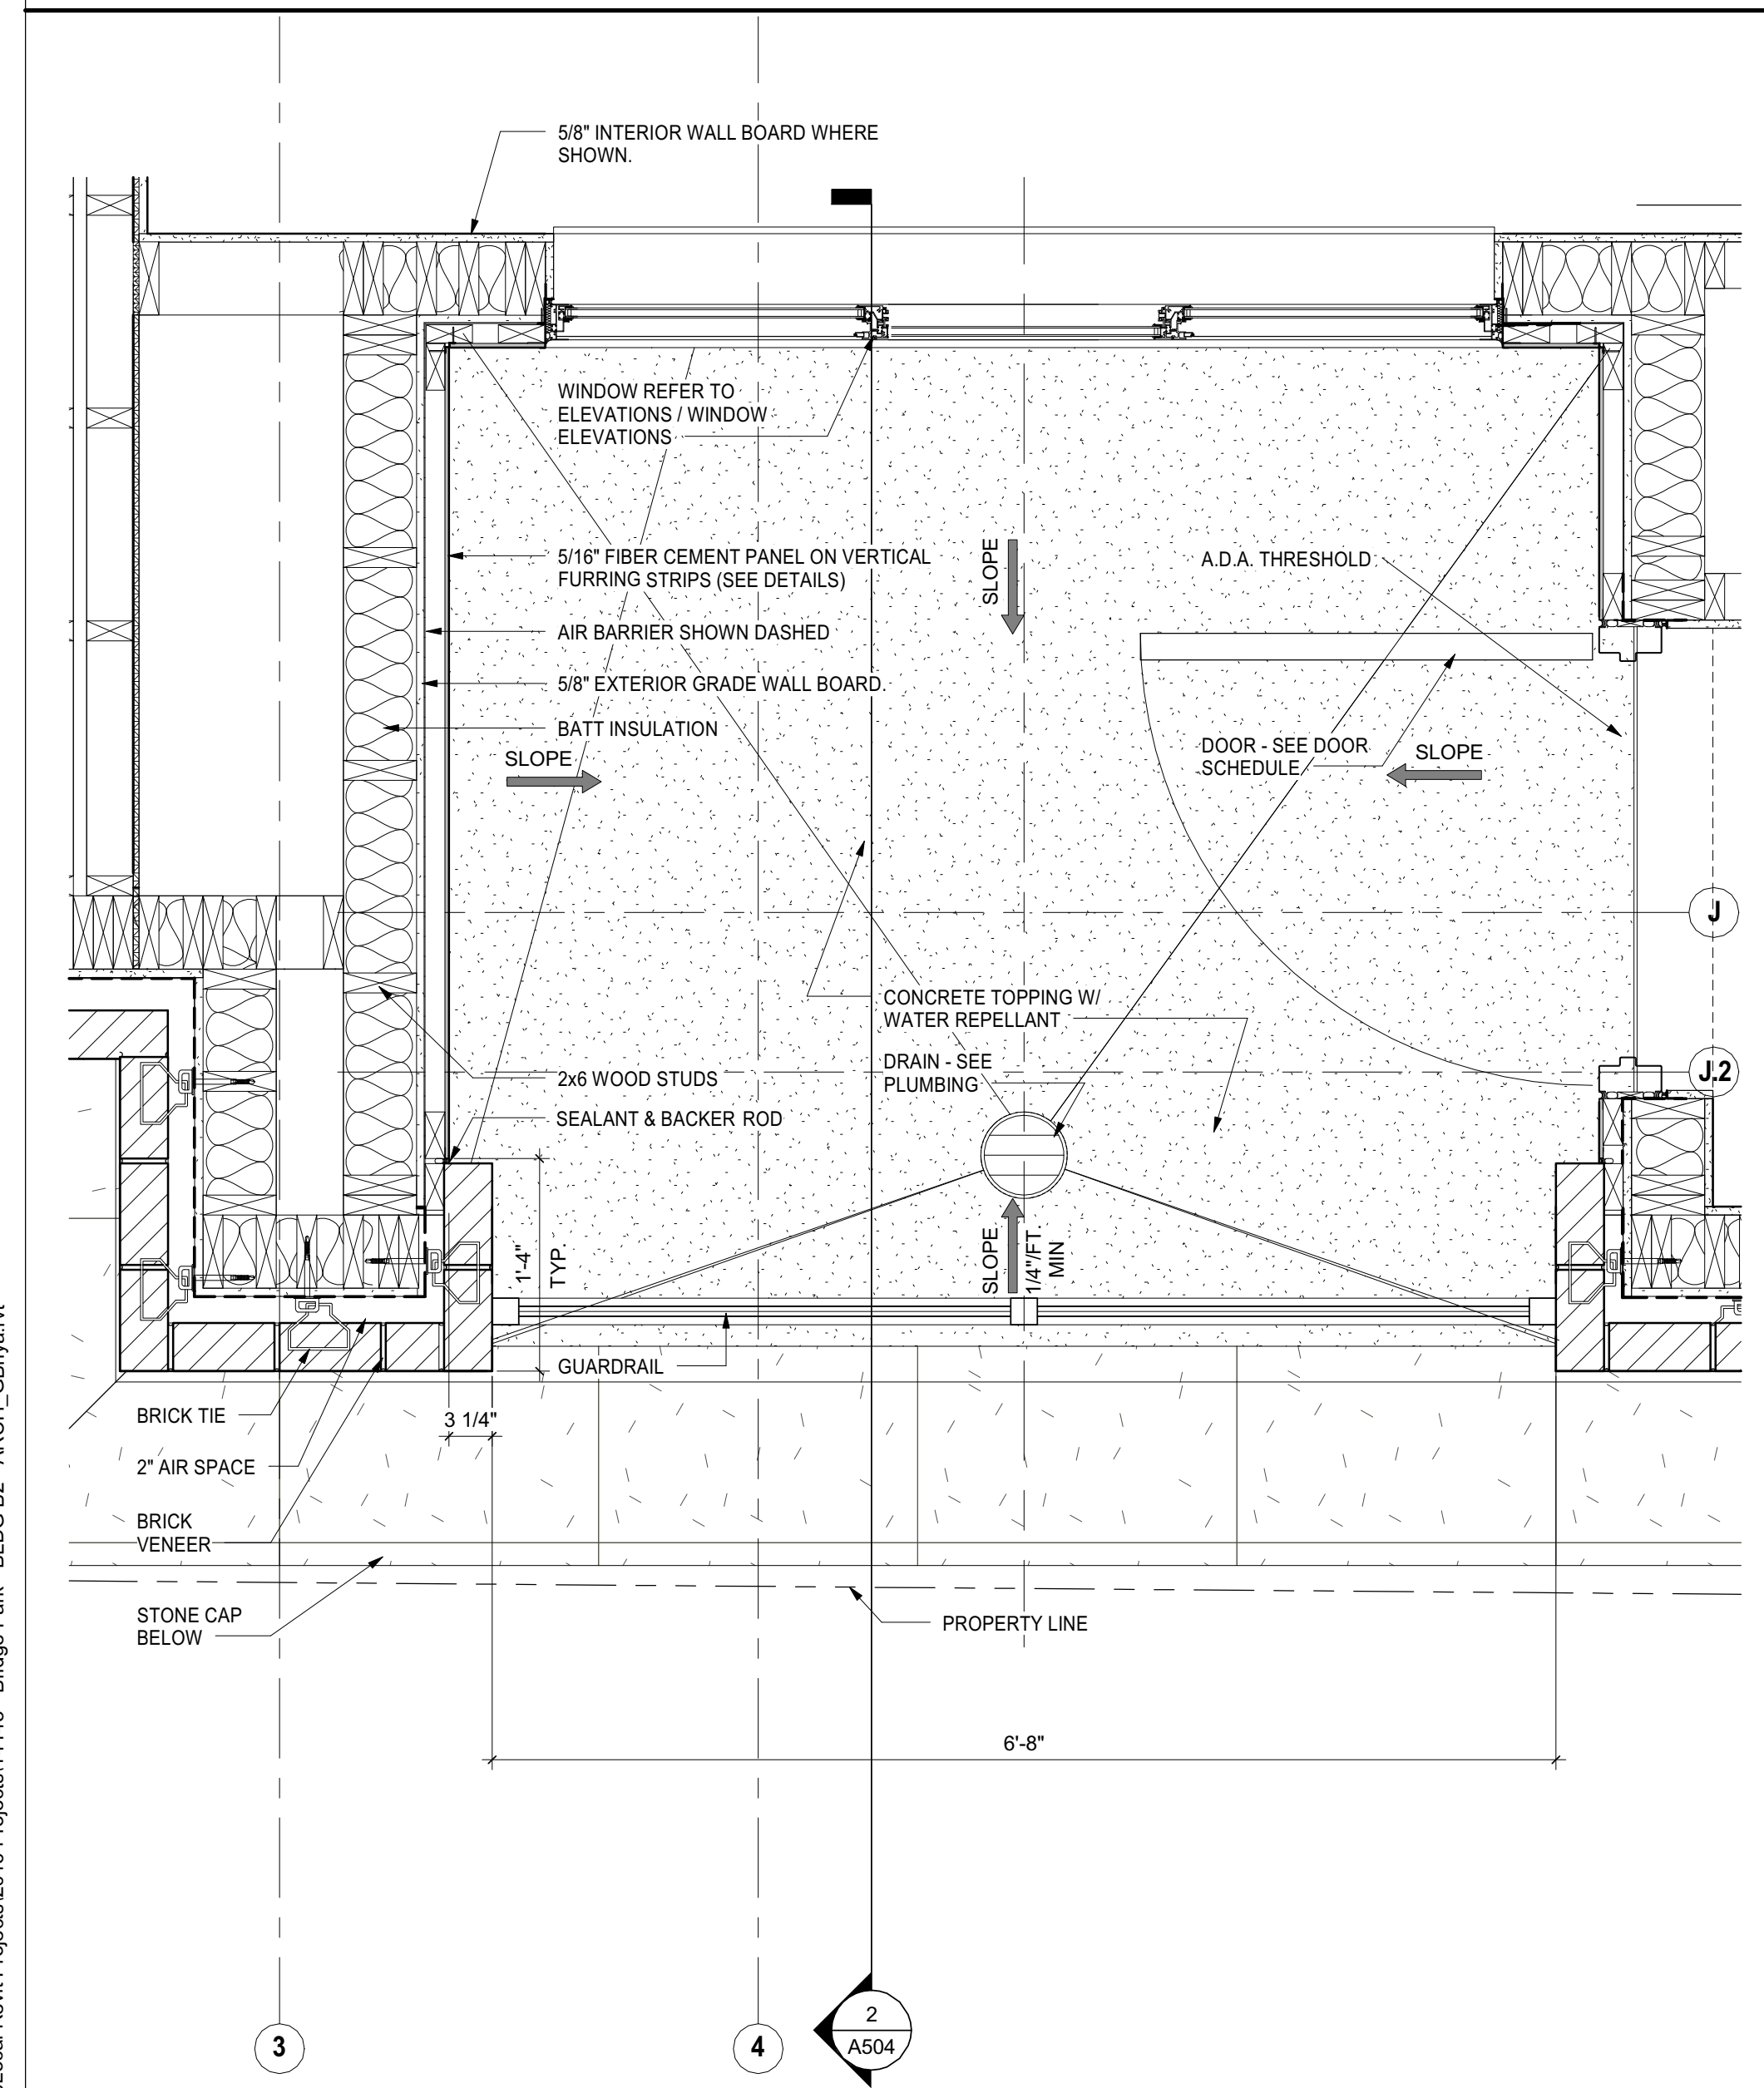

2 PLAN LEVEL 3 - WEST BALCONY
1" = 1'-0"



1 PLAN LEVEL 5 - FLOOR PLAN
1/8" = 1'-0"

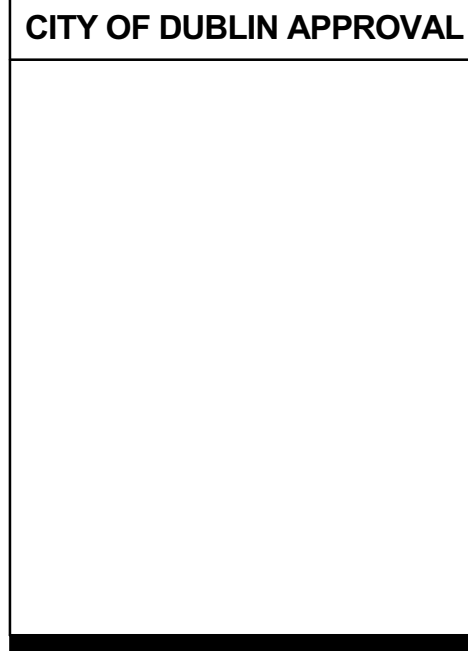

FLOOR PLAN LEGEND

MOODY•NOLAN
RESPONSIVE ARCHITECTURE
300 Spruce Street
Suite 300
Columbus, Ohio 43215
Phone: (614) 461-4664
Fax: (614) 280-8881
www.moodynolan.com

INDICATES PARTITION WITH SOUND ATTENUATION INSULATION. REFER TO THE WALL PARTITION SCHEDULE.
1 HR RATED WALL
2 HR RATED WALL
1 HR RATED WALL

PLANE ELEVATION
MAIL BOX
PARCEL BOX
LINE INDICATES ORIENTATION OF KEYHOLE FOR ANSI COMPLIANCE

SEMI-RECESSED FIRE EXTINGUISHER CABINET. INSTALL FIRE EXTINGUISHER SO THAT THE INTEGRITY OF RATED WALL IS MAINTAINED. CONTINUE TYPE X GYP BOARD ASSEMBLY BEHIND FIRE EXTINGUISHER CABINET. UNIT SHALL NOT ENCRoACH MORE THAN 4" INTO THE PATH OF EGRESS.

PORTABLE FIRE EXTINGUISHER

HEARING IMPAIRED UNIT. SEE MEP INFORMATION FOR ADDITIONAL REQUIREMENTS. SEE CODE FLOOR PLANS FOR LOCATIONS.

TYPE A FULLY ACCESSIBLE UNIT. SEE CODE FLOOR PLANS FOR LOCATIONS.

REQUIRED 30"x48" WHEELCHAIR CLEARANCE. 48" SHALL BE CENTERED AT SINKS AND KITCHEN RANGE.

2'-10" MAXIMUM HEIGHT TO THE TOP OF THE KITCHEN OR BATHROOM SINK RIM. TYP. AT PUBLIC AREAS & TYPE A ANSI UNITS.

ELECTRIC FIRE PLACE AND GYPSUM BOARD SURROUND TYP. AT ALL 1, 2 AND 3-BEDROOM PENTHOUSE UNITS U.N.O.

BALCONY
UNIT INTERIOR
MECHANICAL LOWER PAINT TO MATCH TO EXT. FINISH.


VTAC FLOOR PLAN DIAGRAM (VTAC UNIT TO BE INSTALLED AT TYPICAL RESIDENTIAL LEVELS. AT PENTHOUSE LEVEL ONLY. LOCATE CLOSET AND DOOR IN LIEU OF VTAC UNIT).

TYPICAL ACCESS PANEL LOCATION FOR MECHANICAL UNIT. ACCESS PANEL TO BE PAINTED TO MATCH ADJACENT WALL.

GENERAL NOTES - FLOOR PLAN

- ALL DIMENSIONS ARE TO FACE OF WALL (UNLESS NOTED OTHERWISE).
- SEE STRUCTURAL DRAWINGS FOR LOCATIONS OF ALL STEEL REINFORCING IN WALL & FLOOR CONSTRUCTION.
- SEE FINISH SCHEDULE FOR ADDITIONAL INFORMATION OF LOCATIONS AND TYPES OF FINISH MATERIALS.
- SEE ELEVATIONS AND STRUCTURAL DRAWINGS FOR LOCATIONS OF EXPANSION & CONTROL JOINTS. CONTRACTOR SHALL PROVIDE ADDITIONAL INTERIOR CONTROL JOINTS AS REQUIRED TO COMPLY WITH MAXIMUM SPACING REQUIREMENTS IN SPECIFICATIONS AND NATIONAL MASONRY INSTITUTE. SEE DETAILS ON XXXX.
- MECHANICAL & ELECTRICAL EQUIPMENT SHALL BE ON HOUSEKEEPING PADS. PADS ARE TO PROVIDED BY THE TRADE SUPPLYING THE EQUIPMENT. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION. WORK TO BE COORDINATED THROUGH THE GENERAL TRADES CONTRACTOR. PADS 4" MIN. 4" THICK W/ W.W.F. UNLESS NOTED OTHERWISE.
- SEE G SERIES SHEETS FOR WALL TYPE CONSTRUCTION.
- PROVIDE AN 24" X 36" FIRE RATED ACCESS PANEL PER FLOOR AT ALL KITCHEN GREASE SHAFt LOCATIONS AND EVERY OTHER FLOOR FOR ALL OTHER SHAFt LOCATIONS. ACCESS PANELS TO FACE THE PUBLIC CORRIDOR SIDE. COORDINATE MOUNTING HEIGHT WITH ARCHITECT IN THE FIELD.
- DO NOT RUN PIPELINE, CONDUITS OR ANY DEVICES INTO THE SHAFt ASSEMBLIES. SHAFt ASSEMBLIES TO REMAIN FOR THE SOLE PURPOSE OF THE MECHANICAL DUCTS.
- ELEVATION \$10.00 EQUALS 100'-0".
- INSTALL FIRE EXTINGUISHER SO THAT THE INTEGRITY OF THE RATED WALL IS MAINTAINED. CONTINUE THE TYPE X GYPSUM BOARD ASSEMBLY BEHIND THE FIRE EXTINGUISHER CABINET.
- SEE A600 SERIES SHEETS FOR UNIT LAYOUT INFORMATION.
- REFER TO STRUCTURAL SHEETS FOR BEARING WALL CONDITIONS. COORDINATE SHAFt WALL ALIGNMENT WITH ARCHITECT TO MAINTAIN REQUIRED RATING IN ADJACENT WALLS.

KEY PLAN

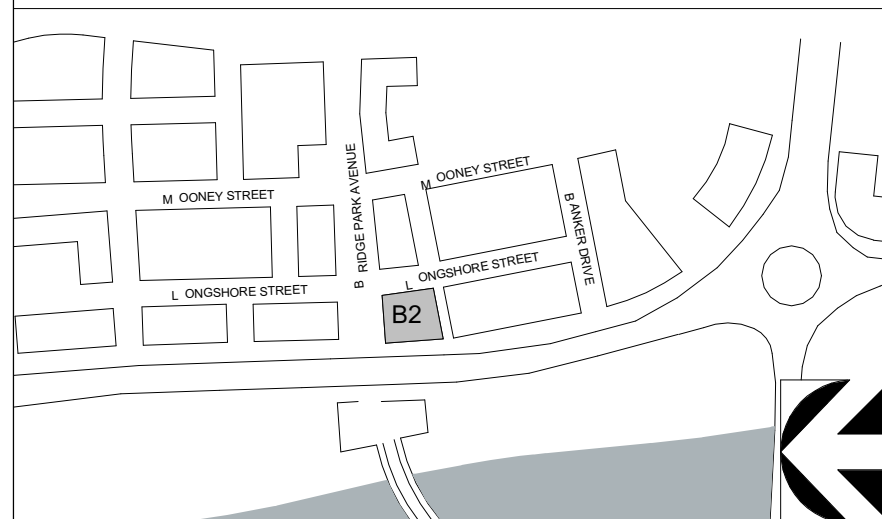

#	DATE	CHANGE DESCRIPTION
1	8-21-15	ADDENDUM #1
5	3-23-16	BULLETIN #4
7	5-27-16	BULLETIN #7
11	Date 11	BULLETIN #13
13	12-22-16	BULLETIN #17

BRIDGE PARK BUILDING B2
6580 RIVERSIDE DR. DUBLIN, OHIO 43017




MOODY•NOLAN
RESPONSIVE ARCHITECTURE
300 Spruce Street
Suite 300
Columbus, Ohio 43215
Phone: (614) 461-4664
Fax: (614) 280-8881
www.moodynolan.com

CURTIS MOODY, LIC #0706
EXP. DATE: 12/31/2015







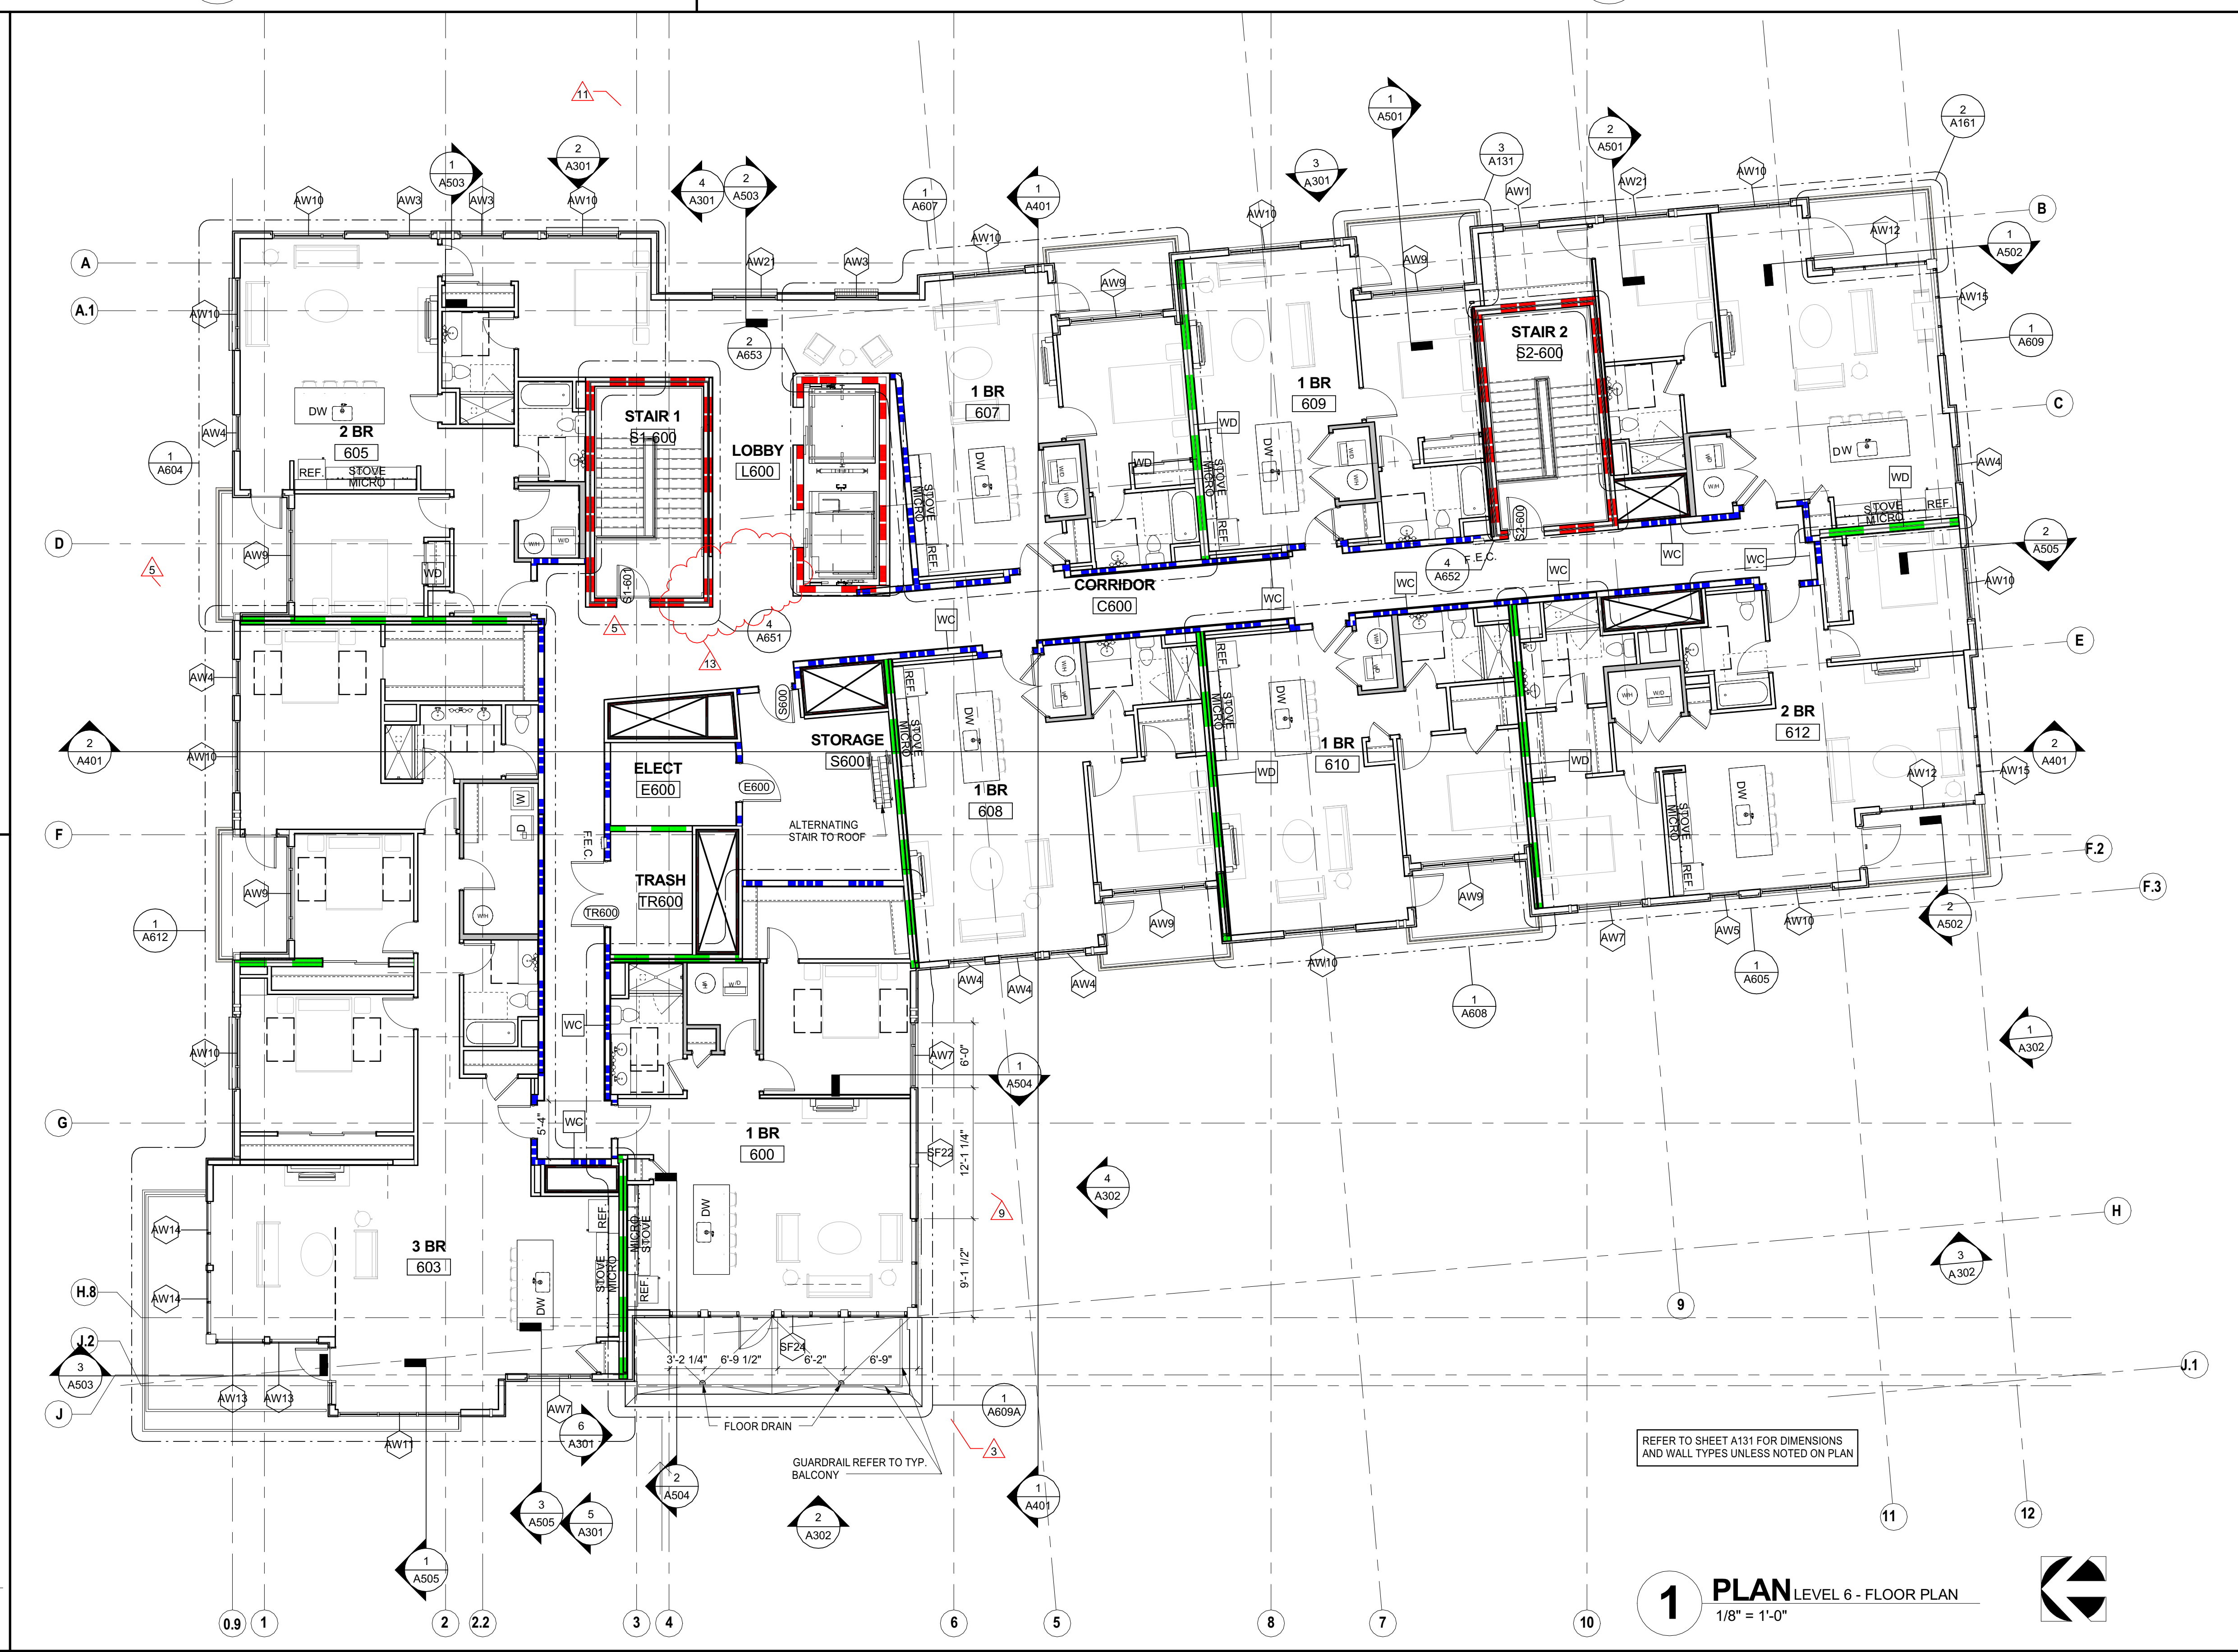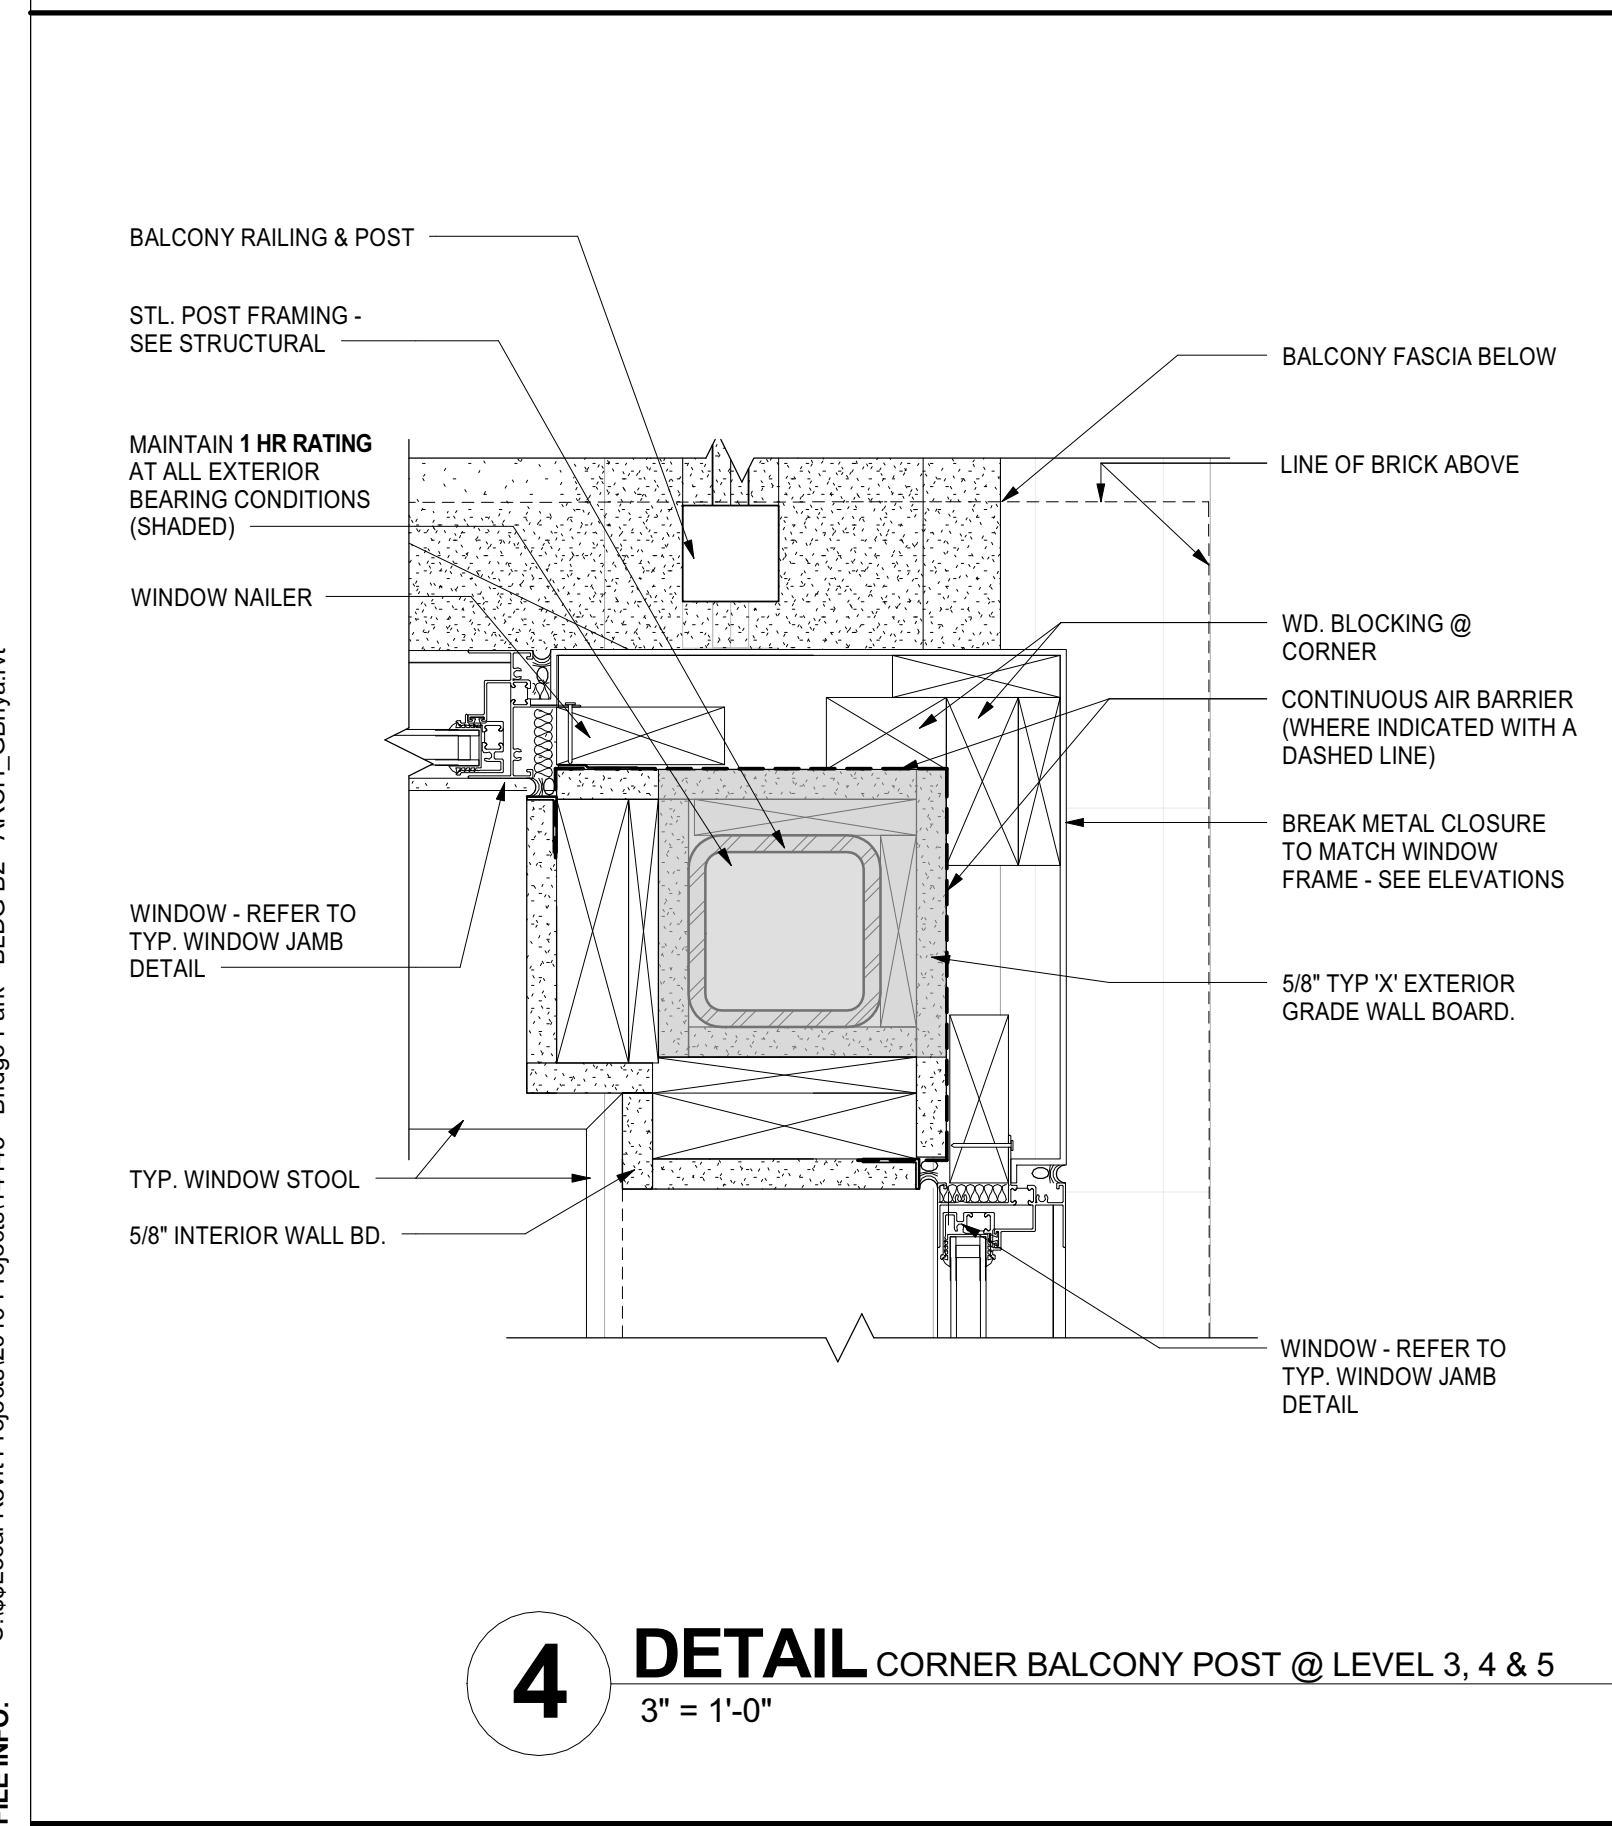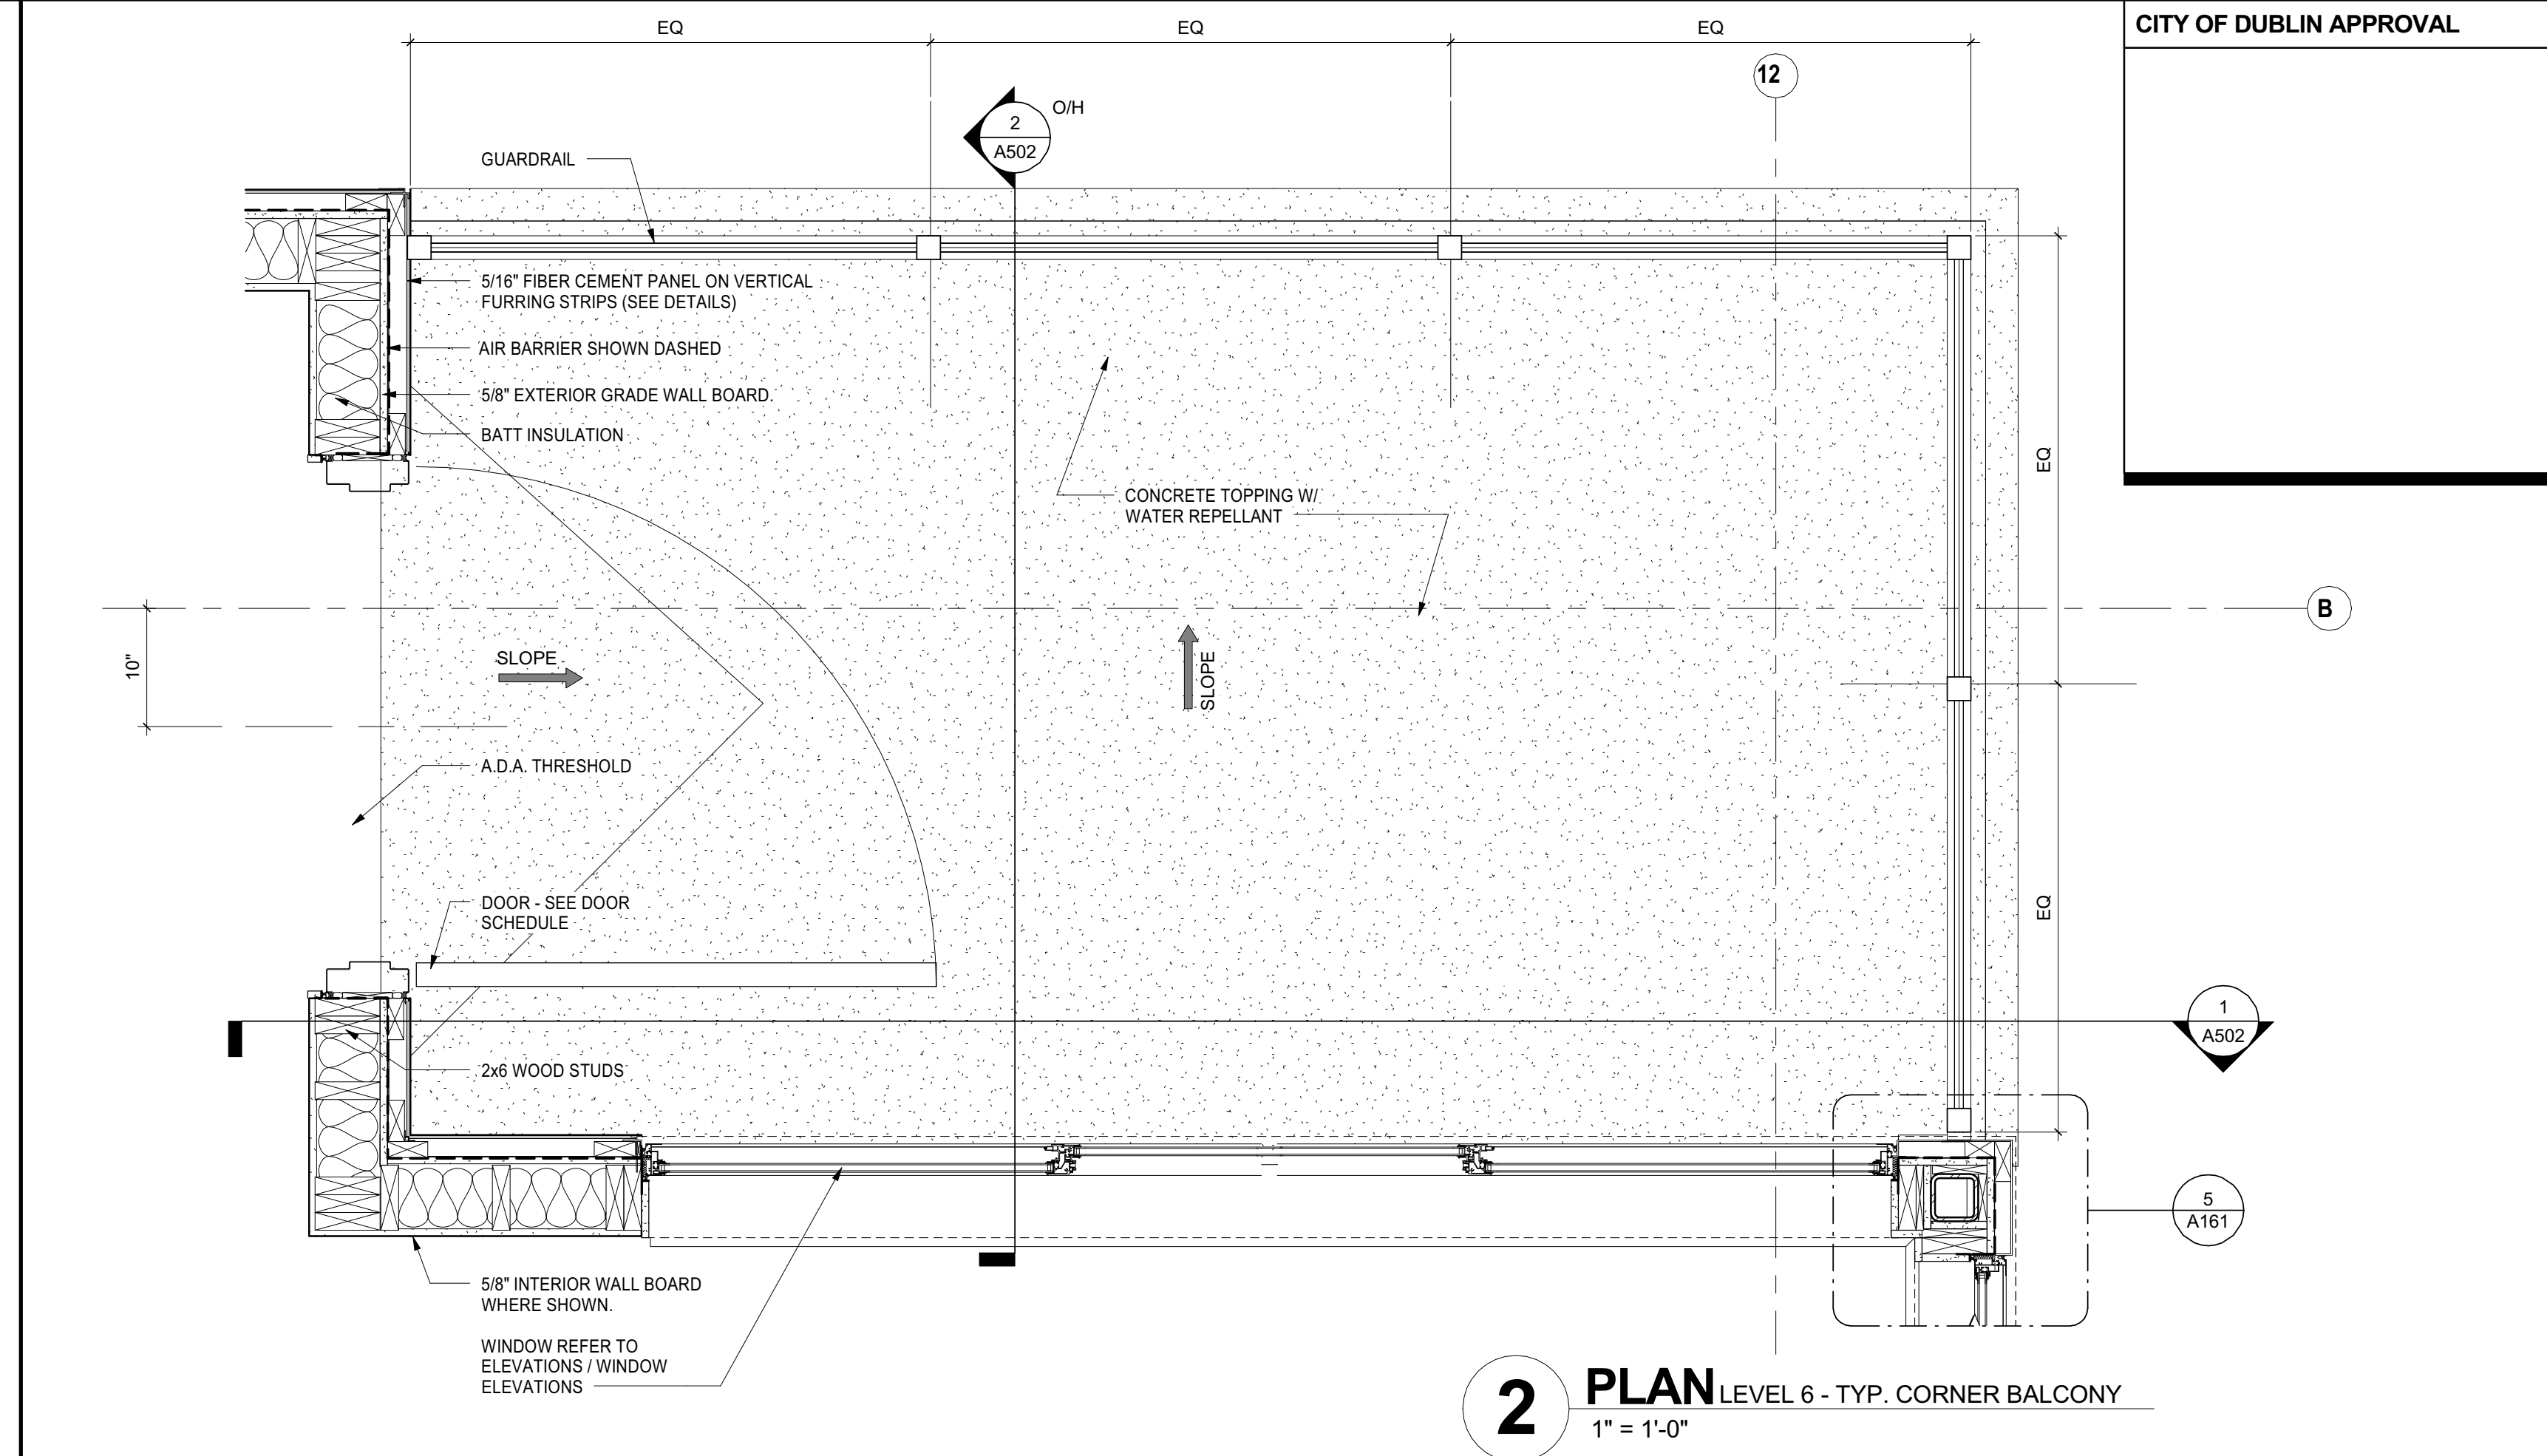


Dwg Coord.: Author Tech. Coord.: Checker 14145

LEVEL 5 - FLOOR PLAN
GMP/PERMITSET

A151
08-03-2015



FLOOR PLAN LEGEND

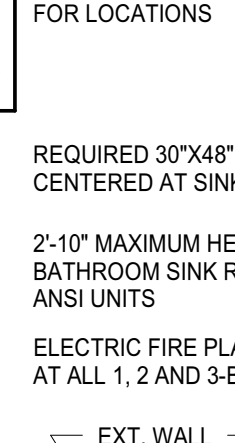 <p>Dublin CITY COUNCIL DUBLIN, IRELAND</p> <p>Approved by: Construction BPS-15-23269.CO M.COM_FPR.1883.</p> <p>36211 02/24/2017</p>	<ul style="list-style-type: none"> INDICATES PARTITION WITH SOUND ATTENUATION INSULATION. REFER TO THE WALL PARTITION SCHEDULE 1HR RATED WALL 2 HR RATED WALL 1 HR RATED WALL
 <p>PLAN ELEVATION</p>  <p>MAIL BOX</p> <p>PARCEL BOX</p> <p>F.E.C.</p> <p>F.E.</p>  <p>HEARING IMPAIRED UNIT. SEE MEP INFORMATION FOR ADDITIONAL REQUIREMENTS. UNIT SHALL COMPLY WITH ACCESS PLANS FOR LOCATIONS</p>	<p>SHALL BE UNLESS NOTED OTHERWISE. SEE CRIBBED DETAILS FOR WALL TYPE, KEYHOLE, RATED ASSEMBLY AND OTHER SPECIALS FOR INTERIOR DETAILS. SHUNT PROVIDE A HORIZONTAL SHUNT PANEL ASSEMBLY AT THE BOTTOM OF THE SHUNT. SEE THROUGH THE POULTRY EQUIPMENT AT SUPPLY AND RETURN AIR FOR RESIDENTIAL CORRIDORS. GENERAL NOTES ON THIS SHEET FOR ACCESS PANEL REQUIREMENTS AT SHUNT ENCLOSURE. SEE THE SHUNT ASSEMBLY VERTICAL DETAILS.</p> <p>SEMI-RECESSED FIRE EXTINGUISHER CABINET. INSTALL FIRE EXTINGUISHER SO THAT THE INTEGRITY OF RATED WALL IS MAINTAINED. CONTINUE TYPE X-CVP BOARD ASSEMBLY BEHIND FIRE EXTINGUISHER CABINET. UNIT SHALL NOT ENCRoACH MORE THAN 4" INTO THE PATH OF EGRESS.</p> <p>PORTABLE FIRE EXTINGUISHER</p>
 <p>TYPE 1 FULLY ACCESSIBLE UNIT. SEE CODE FLOOR PLANS FOR LOCATIONS</p>  <p>REQUIRED 30"x48" WHEEL CHAIR CLEARANCE. 48" SHALL BE CENTERED AT SINKS AND KITCHEN RANGE</p>  <p>2'-10" MAXIMUM HEIGHT TO THE TOP OF THE KITCHEN OR BATHROOM SINK RIM. TYP. AT PUBLIC AREAS & TYPE A SINK UNITS</p>  <p>ELECTRIC FIRE PLACE AND GYPSUM BOARD SURROUND TYP. AT ALL 1, 2 AND 3-BEDROOM PENTHOUSE UNITS U.O.</p>	 <p>VTAC FLOOR PLAN DIAGRAM</p> <p>(VTAC UNIT TO BE INSTALLED AT TYPICAL RESIDENTIAL LEVELS. AT PENTHOUSE LEVEL, ONLY. LOCATE LOCATION AND DOOR IN BLUE) OF VTAC UNIT.</p> <p>TYPICAL ACCESS PANEL LOCATION FOR MECHANICAL UNIT. ACCESS PANEL TO BE PAINTED TO MATCH ADJACENT WALL.</p>

GENERAL NOTES FLOOR PLAN

1. ALL DIMENSIONS ARE TO FACE OF WALL (UNLESS NOTED OTHERWISE).
2. SEE STRUCTURAL DRAWINGS FOR LOCATIONS OF ALL STEEL CONNECTIONS IN WALL & FLOOR.
3. SEE FINISH SCHEDULE FOR ADDITIONAL INFORMATION OF LOCATIONS AND TYPES OF FINISH MATERIALS.
4. SEE STRUCTURAL AND STRUCTURAL DRAWINGS FOR LOCATIONS OF EXPANSION & CONTROL JOINTS. CONTRACTOR SHALL PROVIDE PROPER INTERIOR CORNER REINFORCEMENT TO DEVELOP FULLY WITH MAXIMUM SPACING REQUIREMENTS IN SPECIFICATIONS AND NATIONAL MASONRY INSTITUTE. SEE DETAILS ON AXXII.
5. SEE ELECTRICAL & MECHANICAL DRAWINGS FOR ALL HOUSEKEEPING PADS. PADS ARE TO PROVIDED BY THE TRADE SUPPLIER WITH THE MECHANICAL CONTRACTOR.
6. FOR ADDITIONAL INFORMATION, WORK TO BE COORDINATED THROUGH THE GENERAL TRADE CONTRACTOR. PADS 4" MIN. 4" THICK W/ UNLESS NOTED OTHERWISE.
7. SEE G SERIES SHEETS FOR WALL TYPE CONSTRUCTION.
8. SEE G SERIES SHEETS FOR ALL SHUNT WALLS. CONTRACTOR AT ALL KITCHEN GRABE SHAFT LOCATIONS AND EVERY OTHER FLOOR FOR ALL OTHER SHAFT LOCATIONS. ACCESS PANELS TO FACE THE PUBLIC. COORDINATE WITH ARCHITECT FOR ALL SHUNT WALLS IN THE FIELD.
9. ALL GAS, WATER, PIPELINE, CONDUITS OR ANY DEVICES INTO THE SHAFT ASSEMBLIES. SHAFT ASSEMBLIES TO BE REMOVED FOR THE SOLE PURPOSE OF THE MECHANICAL CONTRACTOR.
10. ELEVATION 0100 EQUALS 100.
11. INSTALL FIRE EXTINGUISHER SO TO THE INTEGRITY OF THE RATED WALL IS MAINTAINED. CONTINUE TO BE RATED. SEE AXXII BOARD ASSEMBLY. BEHIND FIRE EXTINGUISHER CABINET.
12. SEE G SERIES SHEETS FOR UNIT AND ADDITIONAL INFORMATION.
13. ALL WOOD SILL PLATES IN WALLS AT PODIUM LEVEL. TO BE PRESURE TREATED.
14. SEE BEARING WALLS TO BE 1 HOUR RATED PER U/L U304. REFER TO STRUCTURAL SHEETS FOR BEARING WALL CONDITIONS.
15. ALL SHUNT WALLS TO BE 1 HOUR RATED PER ARCHITECT TO MAINTAIN REQUIRED RATING IN ADJACENT WALLS.

BRIDGE PARK BUILDING B2
6580 RIVERSIDE DR. DUBLIN, OHIO 43017

for

MOODY • NOLAN

RESPONSIVE ARCHITECTURE

300 Spruce Street
Suite 300
Columbus, Ohio 43215

Phone: (614) 461-4864
Fax: (614) 280-8881
www.moodynolan.com

CURTIS J. MOODY, LIC. #7066
EXP. DATE: 12/31/2015

Dwg. Coord.: Author Tech. Coord.: Checker

14145

LEVEL 6 - FLOOR PLAN

A161

GMP/PERMITSET

08-03-2015